



**City of Belle Isle Job Site Card ROOFING PERMIT 2018-04-021**

**PERMIT MUST BE POSTED ON SITE** - A permit expires in 6 months if approved inspections are not recorded /scheduled within that time frame. You are responsible for scheduling and keeping track of all your inspections -

Permit Number 2018-04-021

Issue Date: 04-09-2018

Site Address: 1728 Wind Harbor Rd. 32809

Parcel Number: 30-23-30-9330-00-330

Subdivision:

Class: Residential

Description of Work: Roof 30 Squares asphalt shingles and 8 Squares flat

Issued To: Gold Key Roofing

Business Phone: 407 851-0680

Name: Hewitt, Jeffrey

Contractor License CCC1329157

Payment Date & Method: 4 / 9 / 2018

Visa  Master Card  Amex  Discover  Check / Money Order # 0767

**Schedule Inspections via Email at: [BDscheduling@universalengineering.com](mailto:BDscheduling@universalengineering.com)**

**SCHEDULE INSPECTIONS BY 4PM CUT OFF TIME**

**Inspection Results Will Be Sent Out the Following Business Day**

**"WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR AN ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT."**

ROOF	INSPECTOR	DATE	COMMENTS
700 In-progress			
710 Final			

Inspection requests are to be emailed to [BDscheduling@UniversalEngineering.com](mailto:BDscheduling@UniversalEngineering.com); a confirmation email will be sent back to you upon scheduling. Next-Day Inspection requests must be made by 4pm. Please include the following in your request: Permit #, project address, type of inspection, date of the requested inspection, a contact name & a contact phone number. AM or PM may be requested but cannot be guaranteed.

Universal Engineering Sciences - 3532 Maggie Blvd., Orlando, FL 3281  
Tel 407-581-8161 \* Fax 407-581-0313 \* [www.universalengineering.com](http://www.universalengineering.com)



**City of Belle Isle**  
 Universal Engineering Sciences 3532 Maggie Blvd., Orlando, FL 32811  
 Tel 407-581-8161 \* Fax 407-581-0313 \* [www.universalengineering.com](http://www.universalengineering.com)

**RECEIVED**  
 APR 06 2018

**APPLICATION FOR ROOFING PERMIT**

WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. A NOTICE OF COMMENCEMENT MUST BE RECORDED AND POSTED ON THE JOB SITE BEFORE THE FIRST INSPECTION. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR AN ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT.

ROOF PERMIT NUMBER 2018-04-021

DATE OF APPLICATION: \_\_\_\_\_

PLEASE PRINT. The undersigned hereby applies for a permit to make installations as indicated below:

Project Address 1728 WIND HARBOR RD, Belle Isle, FL  32809  32812  
 Property Owner KIM F MILLS Phone \_\_\_\_\_  
 Property Owner's Mailing Address 1728 WIND HARBOR RD City ORLANDO  
 State FL Zip Code 32809 Parcel Id Number: 30-23-30-9330-00-330  
 REQUIRED! To obtain this information, please visit <http://www.ocnafi.org/Searches/ParcelSearch.aspx>

Class of Building: Old  New  Type of Building: Residential  Commercial  Other   
 Type of Work: New Roof  ReRoof

- REQUIRED! Florida Product Approval Screen Printout from [www.floridabuilding.org](http://www.floridabuilding.org) showing the Code Version
- REQUIRED! Florida Product Approval Installation Instructions from [www.floridabuilding.org](http://www.floridabuilding.org) (not the manufacturer instructions)
- REQUIRED! Copies of your General Liability & Worker's Comp Insurance Certificate & State and Local Licenses

Please indicate the nature of work by completing the information below:

Roof Square Footage: 3675/87 FLAT Number of Stories: 1 Job Valuation: \$ 22,816.66  
 Type: Asphalt Shingles  Metal  Modified Bitumen  Other: \_\_\_\_\_

I hereby certify that the above is true and correct to the best of my knowledge and make Application for Permit as outlined above, and if same is granted I agree to conform to all Florida Building Code Regulations and City Ordinances regulating same and in accordance with plans submitted. The issuance of this permit does not grant permission to violate any applicable Town and/or State of Florida codes and/or ordinances. By signing below, I recognize Republic Services is by legal contract the sole authorized provider of garbage, recycling, yard waste, and commercial garbage and construction debris collection and disposal services with the city limits of the City. Contractors, homeowners and commercial businesses may contact Republic Services at 407-293-8000 to setup accounts for Commercial, Construction Roll Off, or other services needed. Rates are fixed by contract and are available at City Hall or from Republic Services. The City enforces the contract through its code enforcement office. Failure to comply will result in a stop work order.

LICENSE HOLDER SIGNATURE [Signature] LICENSE # CC01329157  
 LICENSE HOLDER NAME JESSICA HEWITT COMPANY NAME GOLD KEY  
 Street Address 4874 S. ORANGE AVE  
 City ORLANDO State FL Zip Code 32800 Phone Number 407-851-0680  
 Email Address JESSICA@GOLDKEYROOFING.COM

Building Official: SM Date 4-6-18  
 Verified Contractor's Licenses & Insurance are on file [Signature] Date 4.6.2018  
OK ✓ NOCV ✓

Zoning Fee \$ 30.-  
 Permit Fee \$ 135.-  
 Review Fee \$ 0  
 3% Florida Surcharge \$ 4. mm  
 Total Permit Fee \$ 169.-


NOTE: The Building Permit Number is required if the Roof Installation is associated with any construction or alteration where a Building Permit has been issued.

1ST IC 25  
 2x5 110  
 135

**PAID**  
4-9-2018  
 VISA 0767

Permit Number: \_\_\_\_\_  
 Folio/Parcel ID #: 30-23-30-9330-00-330  
 Prepared by: Gold Key  
4874 S Orange Ave  
Orlando, FL 32806  
 Return to: Gold Key  
4874 S Orange Ave  
Orlando, FL 32806

DOCH 20180153584  
 03/16/2018 09:24:14 AM Page 1 of 1  
 Rec Fee: \$10.00  
 Phil Diamond, Comptroller  
 Orange County, FL  
 IP - Ret To: GOLD KEY



**NOTICE OF COMMENCEMENT**

State of Florida, County of Orange  
 The undersigned hereby gives notice that improvement will be made to certain real property, and in accordance with Chapter 713, Florida Statutes, the following information is provided in this Notice of Commencement.

- Description of property (legal description of the property, and street address if available)  
WIND HARBOR 7/60 LOT 33-1728 WIND HARBOR RD
- General description of improvement  
ReRoof
- Owner information or Lessee information if the Lessee contracted for the improvement  
 Name KIM F MILLS  
 Address 1728 WIND HARBOR RD ORLANDO 32809  
 Interest in Property OWNER  
 Name and address of fee simple titleholder (if different from Owner listed above)  
 Name N/A  
 Address N/A
- Contractor  
 Name Gold Key Roofing Telephone Number 407-851-0680  
 Address 4874 S Orange Ave Orlando, FL 32806
- Surety (if applicable, a copy of the payment bond is attached)  
 Name N/A Telephone Number N/A  
 Address N/A Amount of Bond \$ N/A
- Lender  
 Name N/A Telephone Number N/A  
 Address N/A
- Persons within the State of Florida designated by Owner upon whom notices or other documents may be served as provided by §713.13(1)(a)7, Florida Statutes.  
 Name N/A Telephone Number N/A  
 Address N/A
- In addition to himself or herself, Owner designates the following to receive a copy of the Lienor's Notice as provided in §713.13(1)(b), Florida Statutes.  
 Name N/A Telephone Number N/A  
 Address N/A
- Expiration date of notice of commencement (the expiration date may not be before the completion of construction and final payment to the contractor, but will be 1 year from the date of recording unless a different date is specified) N/A



STATE OF FLORIDA, County of ORANGE  
 I hereby certify that this is a true copy of the document as reflected in the Official Records  
 PHIL DIAMOND, COUNTY COMPTROLLER  
 BY: Phil Diamond  
 DATED: 03-16-18

**WARNING TO OWNER: ANY PAYMENTS MADE BY THE OWNER AFTER THE EXPIRATION OF THE NOTICE OF COMMENCEMENT ARE CONSIDERED IMPROPER PAYMENTS UNDER CHAPTER 713, PART I, SECTION 713.13, FLORIDA STATUTES, AND CAN RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. A NOTICE OF COMMENCEMENT MUST BE RECORDED AND POSTED ON THE JOB SITE BEFORE THE FIRST INSPECTION. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR AN ATTORNEY BEFORE COMMENCING WORK OR RECORDING YOUR NOTICE OF COMMENCEMENT.**

Signature of Owner or Lessee, or Owner's or Lessee's Authorized Officer/Director/Partner/Manager  
 \_\_\_\_\_  
 Owner  
 Signatory's Title/Office  
 \_\_\_\_\_  
 The foregoing instrument was acknowledged before me this 9 day of 3/18 by KIM I MILLS  
 as himself for himself name of person  
 \_\_\_\_\_  
 Type of authority, e.g., officer, trustee, attorney in fact  
 Name of party on behalf of whom instrument was executed  
Jessica N. Grace  
 Signature of Notary Public - State of Florida  
 Print, type, or stamp commissioned name of Notary Public  
 \_\_\_\_\_  
 Personally Known OR Produced ID FL DL  
 Type of ID Produced \_\_\_\_\_



Harry W. Hewitt  
(407)851-0680

Address: 4874 S. Orange Avenue  
EDGEWOOD FL 32806  
Activity: ROOFING AND CONSTRUCTION

Issued to: Gold Key Roofing  
Harry W. Hewitt  
4874 S. Orange Avenue  
EDGEWOOD FL 32806

**CITY OF EDGEWOOD**  
LOCAL BUSINESS TAX RECEIPT

405 LARUE AVENUE, EDGEWOOD FL 32809-3406  
LICENSE YEAR: OCT 1, 2017 - SEPT 30, 2018



No: 1872

Date: 8/14/17

BUS TAX 98.12  
PENALTY  
TRANSFER

**Total Paid 98.12**  
October 1 0.00  
November 1 0.00  
December 1 0.00  
January 1 0.00

Bea L. Meeks, CBTO, City Clerk

MUST BE POSTED CONSPICUOUSLY AT PLACE OF BUSINESS

A



STATE OF FLORIDA  
DEPARTMENT OF BUSINESS AND PROFESSIONAL REGULATION

(850) 487-1395

CONSTRUCTION INDUSTRY LICENSING BOARD  
2601 BLAIR STONE ROAD  
TALLAHASSEE FL 32399-0783

HEWITT, JEFFREY ALLAN  
GOLD KEY ROOFING LLC  
6021 SOUTH ORANGE AVENUE  
ORLANDO FL 32809

Congratulations! With this license you become one of the nearly one million Floridians licensed by the Department of Business and Professional Regulation. Our professionals and businesses range from architects to yacht brokers, from boxers to barbecue restaurants, and they keep Florida's economy strong.

Every day we work to improve the way we do business in order to serve you better. For information about our services, please log onto [www.myfloridalicense.com](http://www.myfloridalicense.com). There you can find more information about our divisions and the regulations that impact you, subscribe to department newsletters and learn more about the Department's initiatives.

Our mission at the Department is: License Efficiently, Regulate Fairly. We constantly strive to serve you better so that you can serve your customers. Thank you for doing business in Florida, and congratulations on your new license!



STATE OF FLORIDA  
DEPARTMENT OF BUSINESS AND  
PROFESSIONAL REGULATION

CCC1329157

ISSUED: 08/16/2016

CERTIFIED ROOFING CONTRACTOR  
HEWITT, JEFFREY ALLAN  
GOLD KEY ROOFING LLC

IS CERTIFIED under the provisions of Ch. 489 FS.  
Expiration date AUG 31, 2018 L1608160002259

DETACH HERE

RICK SCOTT, GOVERNOR

KEN LAWSON, SECRETARY

STATE OF FLORIDA  
DEPARTMENT OF BUSINESS AND PROFESSIONAL REGULATION  
CONSTRUCTION INDUSTRY LICENSING BOARD

LICENSE NUMBER

CCC1329157

The ROOFING CONTRACTOR  
Named below IS CERTIFIED  
Under the provisions of Chapter 489 FS.  
Expiration date: AUG 31, 2018

HEWITT, JEFFREY ALLAN  
GOLD KEY ROOFING LLC  
6021 SOUTH ORANGE AVENUE  
ORLANDO FL 32809



ISSUED: 08/16/2016

DISPLAY AS REQUIRED BY LAW

SEQ # L1608160002259



# CERTIFICATE OF LIABILITY INSURANCE

DATE (MM/DD/YYYY)  
12/13/2017

**THIS CERTIFICATE IS ISSUED AS A MATTER OF INFORMATION ONLY AND CONFERS NO RIGHTS UPON THE CERTIFICATE HOLDER. THIS CERTIFICATE DOES NOT AFFIRMATIVELY OR NEGATIVELY AMEND, EXTEND OR ALTER THE COVERAGE AFFORDED BY THE POLICIES BELOW. THIS CERTIFICATE OF INSURANCE DOES NOT CONSTITUTE A CONTRACT BETWEEN THE ISSUING INSURER(S), AUTHORIZED REPRESENTATIVE OR PRODUCER, AND THE CERTIFICATE HOLDER.**

**IMPORTANT:** If the certificate holder is an **ADDITIONAL INSURED**, the policy(ies) must be endorsed. If **SUBROGATION IS WAIVED**, subject to the terms and conditions of the policy, certain policies may require an endorsement. A statement on this certificate does not confer rights to the certificate holder in lieu of such endorsement(s).

<b>PRODUCER</b> FRSA Self Insurers Fund, Inc. 4099 Metric Drive Winter Park, FL 32792	CONTACT NAME: Debra Guidry, CPCU PHONE (A/C, No, Ext): (800) 767-3772 E-MAIL ADDRESS: debra@frsasif.com FAX (A/C, No): (407) 671-2520														
<b>INSURED</b> Gold Key Roofing, LLC 4874 S. Orange Avenue Orlando, FL 32806	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th style="text-align: center;">INSURER(S) AFFORDING COVERAGE</th> <th style="text-align: center;">NAIC #</th> </tr> <tr> <td>INSURER A: FRSA Self Insurers Fund / Evanston Insurance Co.</td> <td style="text-align: center;">35378</td> </tr> <tr> <td>INSURER B:</td> <td></td> </tr> <tr> <td>INSURER C:</td> <td></td> </tr> <tr> <td>INSURER D:</td> <td></td> </tr> <tr> <td>INSURER E:</td> <td></td> </tr> <tr> <td>INSURER F:</td> <td></td> </tr> </table>	INSURER(S) AFFORDING COVERAGE	NAIC #	INSURER A: FRSA Self Insurers Fund / Evanston Insurance Co.	35378	INSURER B:		INSURER C:		INSURER D:		INSURER E:		INSURER F:	
INSURER(S) AFFORDING COVERAGE	NAIC #														
INSURER A: FRSA Self Insurers Fund / Evanston Insurance Co.	35378														
INSURER B:															
INSURER C:															
INSURER D:															
INSURER E:															
INSURER F:															

**COVERAGES** **CERTIFICATE NUMBER:** **REVISION NUMBER:**

THIS IS TO CERTIFY THAT THE POLICIES OF INSURANCE LISTED BELOW HAVE BEEN ISSUED TO THE INSURED NAMED ABOVE FOR THE POLICY PERIOD INDICATED. NOTWITHSTANDING ANY REQUIREMENT, TERM OR CONDITION OF ANY CONTRACT OR OTHER DOCUMENT WITH RESPECT TO WHICH THIS CERTIFICATE MAY BE ISSUED OR MAY PERTAIN, THE INSURANCE AFFORDED BY THE POLICIES DESCRIBED HEREIN IS SUBJECT TO ALL THE TERMS, EXCLUSIONS AND CONDITIONS OF SUCH POLICIES. LIMITS SHOWN MAY HAVE BEEN REDUCED BY PAID CLAIMS.

INSR LTR	TYPE OF INSURANCE	ADDL SUBR		POLICY NUMBER	POLICY EFF (MM/DD/YYYY)	POLICY EXP (MM/DD/YYYY)	LIMITS	
		INSR	WVD					
	COMMERCIAL GENERAL LIABILITY <input type="checkbox"/> CLAIMS-MADE <input type="checkbox"/> OCCUR  GEN'L AGGREGATE LIMIT APPLIES PER: <input type="checkbox"/> POLICY <input type="checkbox"/> PRO-JECT <input type="checkbox"/> LOC OTHER:			N/A			EACH OCCURRENCE	\$
	AUTOMOBILE LIABILITY <input type="checkbox"/> ANY AUTO <input type="checkbox"/> ALL OWNED AUTOS <input type="checkbox"/> HIRED AUTOS <input type="checkbox"/> SCHEDULED AUTOS <input type="checkbox"/> NON-OWNED AUTOS			N/A			COMBINED SINGLE LIMIT (Ea accident)	\$
	UMBRELLA LIAB <input type="checkbox"/> OCCUR EXCESS LIAB <input type="checkbox"/> CLAIMS-MADE DED <input type="checkbox"/> RETENTION \$			N/A			EACH OCCURRENCE	\$
A	WORKERS COMPENSATION AND EMPLOYERS' LIABILITY ANY PROPRIETOR/PARTNER/EXECUTIVE OFFICER/MEMBER EXCLUDED? (Mandatory in NH) If yes, describe under DESCRIPTION OF OPERATIONS below	Y/N <input checked="" type="checkbox"/> N	N/A	870-040079 / 3DY3150	01/01/2018	01/01/2019	<input checked="" type="checkbox"/> PER STATUTE <input type="checkbox"/> OTH-ER E.L. EACH ACCIDENT \$ 1,000,000 E.L. DISEASE - EA EMPLOYEE \$ 1,000,000 E.L. DISEASE - POLICY LIMIT \$ 1,000,000	

DESCRIPTION OF OPERATIONS / LOCATIONS / VEHICLES (ACORD 101, Additional Remarks Schedule, may be attached if more space is required)  
 REMARKS: Non-cancelable, without 30 days prior written notice, except for non-payment of premium which will be a 10 day written notice.  
 Jeffrey Allan Hewitt, Qualifier  
 Lic #CCC1329157

<b>CERTIFICATE HOLDER</b>  Attn:  City of Belle Isle 1600 Nela Ave. Belle Isle, FL 32809	<b>CANCELLATION</b>  SHOULD ANY OF THE ABOVE DESCRIBED POLICIES BE CANCELLED BEFORE THE EXPIRATION DATE THEREOF, NOTICE WILL BE DELIVERED IN ACCORDANCE WITH THE POLICY PROVISIONS.  AUTHORIZED REPRESENTATIVE Debra Guidry CPCU Underwriting Manager <div style="text-align: right; font-size: 1.5em; margin-top: 10px;"> </div>
--	---



# CERTIFICATE OF LIABILITY INSURANCE

DATE (MM/DD/YYYY)  
2/15/2018

THIS CERTIFICATE IS ISSUED AS A MATTER OF INFORMATION ONLY AND CONFERS NO RIGHTS UPON THE CERTIFICATE HOLDER. THIS CERTIFICATE DOES NOT AFFIRMATIVELY OR NEGATIVELY AMEND, EXTEND OR ALTER THE COVERAGE AFFORDED BY THE POLICIES BELOW. THIS CERTIFICATE OF INSURANCE DOES NOT CONSTITUTE A CONTRACT BETWEEN THE ISSUING INSURER(S), AUTHORIZED REPRESENTATIVE OR PRODUCER, AND THE CERTIFICATE HOLDER.

IMPORTANT: If the certificate holder is an ADDITIONAL INSURED, the policy(ies) must be endorsed. If SUBROGATION IS WAIVED, subject to the terms and conditions of the policy, certain policies may require an endorsement. A statement on this certificate does not confer rights to the certificate holder in lieu of such endorsement(s).

<b>PRODUCER</b> Frank H. Furman, Inc. 1314 East Atlantic Blvd. P. O. Box 1927 Pompano Beach FL 33061  <b>INSURED</b> Gold Key Roofing, LLC Gold Key International Inc 4874 S. Orange Avenue  Orlando FL 32806	<b>CONTACT NAME:</b> Griseldys Acosta <b>PHONE (A/C, No, Ext):</b> (954) 943-5050 <b>E-MAIL ADDRESS:</b> gris@furmaninsurance.com <b>FAX (A/C, No):</b> (954) 942-6310  <b>INSURER(S) AFFORDING COVERAGE</b> <b>INSURER A:</b> Security National Insurance Company NAIC # 33120 <b>INSURER B:</b> MAPFRE <b>INSURER C:</b> <b>INSURER D:</b> <b>INSURER E:</b> <b>INSURER F:</b>
---	---

COVERAGES      CERTIFICATE NUMBER: 18/19 MASTER      REVISION NUMBER:

THIS IS TO CERTIFY THAT THE POLICIES OF INSURANCE LISTED BELOW HAVE BEEN ISSUED TO THE INSURED NAMED ABOVE FOR THE POLICY PERIOD INDICATED. NOTWITHSTANDING ANY REQUIREMENT, TERM OR CONDITION OF ANY CONTRACT OR OTHER DOCUMENT WITH RESPECT TO WHICH THIS CERTIFICATE MAY BE ISSUED OR MAY PERTAIN, THE INSURANCE AFFORDED BY THE POLICIES DESCRIBED HEREIN IS SUBJECT TO ALL THE TERMS, EXCLUSIONS AND CONDITIONS OF SUCH POLICIES. LIMITS SHOWN MAY HAVE BEEN REDUCED BY PAID CLAIMS.

INSR LTR	TYPE OF INSURANCE	ADDL SUBR INSD. WVO	POLICY NUMBER	POLICY EFF (MM/DD/YYYY)	POLICY EXP (MM/DD/YYYY)	LIMITS
A	<input checked="" type="checkbox"/> COMMERCIAL GENERAL LIABILITY <input type="checkbox"/> CLAIMS-MADE <input checked="" type="checkbox"/> OCCUR  GEN'L AGGREGATE LIMIT APPLIES PER: <input type="checkbox"/> POLICY <input checked="" type="checkbox"/> PROJECT <input type="checkbox"/> LOC  OTHER:		SES154145300	2/19/2018	2/19/2019	EACH OCCURRENCE \$ 1,000,000 DAMAGE TO RENTED PREMISES (Ea occurrence) \$ 100,000 MED EXP (Any one person) \$ 5,000 PERSONAL & ADV INJURY \$ 1,000,000 GENERAL AGGREGATE \$ 2,000,000 PRODUCTS - COM/OP AGG \$ 2,000,000 Employee Benefits Liability \$ 1,000,000
B	<b>AUTOMOBILE LIABILITY</b> <input checked="" type="checkbox"/> ANY AUTO <input type="checkbox"/> ALL OWNED AUTOS <input type="checkbox"/> SCHEDULED AUTOS <input checked="" type="checkbox"/> HIRED AUTOS <input checked="" type="checkbox"/> NON-OWNED AUTOS		5204070002276	2/19/2018	2/19/2019	COMBINED SINGLE LIMIT (Ea accident) \$ 1,000,000 BODILY INJURY (Per person) \$ BODILY INJURY (Per accident) \$ PROPERTY DAMAGE (Per accident) \$ PIP-Basic \$ 10,000 EACH OCCURRENCE \$ AGGREGATE \$
	UMBRELLA LIAB <input type="checkbox"/> OCCUR EXCESS LIAB <input type="checkbox"/> CLAIMS-MADE DED    RETENTION \$					PER STATUTE    OTH-ER E.L. EACH ACCIDENT \$ E.L. DISEASE - EA EMPLOYEE \$ E.L. DISEASE - POLICY LIMIT \$
	<b>WORKERS COMPENSATION AND EMPLOYERS' LIABILITY</b> ANY PROPRIETOR/PARTNER/EXECUTIVE OFFICER/MEMBER EXCLUDED? (Mandatory in NH) If yes, describe under DESCRIPTION OF OPERATIONS below	Y/N	N/A			

DESCRIPTION OF OPERATIONS / LOCATIONS / VEHICLES (ACORD 101, Additional Remarks Schedule, may be attached if more space is required)

<b>CERTIFICATE HOLDER</b>  City of Belle Isle 1600 Nela Ave Orlando, FL 32809	<b>CANCELLATION</b>  SHOULD ANY OF THE ABOVE DESCRIBED POLICIES BE CANCELLED BEFORE THE EXPIRATION DATE THEREOF, NOTICE WILL BE DELIVERED IN ACCORDANCE WITH THE POLICY PROVISIONS.  AUTHORIZED REPRESENTATIVE Dirk DeJong/GA
---	--



Sign up for e-Notify

- Searches
- Sales Search
- Results
- Property Record Card**
- My Favorites

**1728 Wind Harbor Rd** < 30-23-30-9330-00-330 >

Name(s)  
**Mills Kim I**

Mailing Address On File  
**1728 Wind Harbor Rd  
Belle Isle, FL 32809-6846**

Incorrect Mailing Address?

Physical Street Address  
**1728 Wind Harbor Rd**

Postal City and Zipcode  
**Orlando, FL 32809**

Property Use  
**0103 - Single Fam Class III**

Municipality  
**Belle Isle**



[View 2017 Property Record Card](#)

- Property Features
- Values, Exemptions and Taxes**
- Sales Analysis
- Location Info
- Market Stats
- Update Information

**2018 values will be available in August of 2018.**

[View Plat](#)

**Property Description**

WIND HARBOR 7/60 LOT 33

**Total Land Area** 14,518 sqft (+/-) | 0.33 acres (+/-) GIS Calculated Notice

**Land**

Land Use Code	Zoning	Land Units	Unit Price	Land Value	Class Unit Price	Class Value
0100 - Single Family	R-1-AA	1 LOT(S)	working...	working...	working...	working...

Page 1 of 1 (1 total records)

**Buildings**

Important Information		Structure				
	<b>Model Code:</b>	01 - Single Fam Residence	<b>Actual Year Built:</b>	1979	<b>Gross Area:</b>	3086 sqft
	<b>Type Code:</b>	0103 - Single Fam Class III	<b>Beds:</b>	3	<b>Living Area:</b>	1940 sqft
	<b>Building Value:</b>	working...	<b>Baths:</b>	2.0	<b>Exterior Wall:</b>	Concrete Block Stucco
	<b>Estimated New Cost:</b>	working...	<b>Floors:</b>	1	<b>Interior Wall:</b>	Drywall

Page 1 of 1 (1 total records)

**Extra Features**

Description	Date Built	Units	XFOB Value
FPL2 - Average Fireplace	01/01/1979	1 Unit(s)	working...
PL2 - Above Average Pool	01/01/1979	1 Unit(s)	working...

Page 1 of 1 (2 total records)

This Data Printed on 03/09/2018 and System Data Last Refreshed on 03/08/2018





## City of Belle Isle

Universal Engineering Sciences 3532 Maggie Blvd., Orlando, FL 32811  
 Tel 407-581-8161 \* Fax 407-581-0313 \* [www.universalengineering.com](http://www.universalengineering.com)

### Product Approval Form

DATE: \_\_\_\_\_

PERMIT # \_\_\_\_\_

PROJECT ADDRESS

**1728 WIND HARBOR RD**

Belle Isle, FL  32809  32812

As required by Florida Statute 553.842 and Florida Administrative Code 9B-72m, please provide the information and approval numbers of the building components listed below if they will be utilized on the building or structure. FL Approved products are listed online at [www.floridabuilding.org](http://www.floridabuilding.org) or can be obtained from the local product supplier. The following information must be turned in with permit application and available onsite for inspections:

1. This Product Approval Cover Sheet
2. Internet screen from FloridaBuilding.org showing PA#, approval and code edition stamped
3. Manufacturer's installation details from FloridaBuilding.org and requirements for each product stamped

Product Type	Manufacturer	Model/Series	FL Product Approval #	Product Type	Manufacturer	Model/Series	FL Product Approval #
<b>EXTERIOR DOORS</b>				<b>WALL PANELS</b>			
Swinging				Sliding			
Sliding				Soffits			
Sectional/Rollup				Storefront			
Other				Glass Block			
<b>WINDOWS</b>				<b>ROOFING PRODUCTS</b>			
Single/Dbl Hung				Asphalt Shingles		<b>CERTAINTEED ASPHALT FL3444-R13</b>	
Horizontal Slider				Non Struct Metal			
Casement				Roofing Tiles			
Fixed				Single Ply Roof		<b>CERTAINTEED FLINTASTIC FL2533-R19</b>	
Mullion				Other			
Skylights				<b>UNDERLAYMENT</b>			
Other				<b>CERTAINTEED ROOFRUNNER FL21841-R2</b>			
<b>STRUCTURAL COMPONENTS</b>				<b>OTHER</b>			
Wood Connectors							
Wood Anchors							
Truss Plates							
Insulation Forms							
Lintels							
Other							

It is the applicant's responsibility to verify that specific products have been installed in accordance with their limitations and with the minimum required design pressures for the structure. Specific compliance will be verified during field inspections.

Applicant Signature \_\_\_\_\_

Date \_\_\_\_\_



BCIS Home | Log In | User Registration | Hot Topics | Submit Surcharge | Stats & Facts | Publications | FBC Staff | BCIS Site Map | Links | Search



**Product Approval**  
USER: Public User

[Product Approval Menu](#) > [Product or Application Search](#) > [Application List](#) > **Application Detail**

OFFICE OF THE SECRETARY

FL #	FL5444-R13
Application Type	Revision
Code Version	2017
Application Status	Pending FBC Approval
Comments	
Archived	
Product Manufacturer	CertainTeed Corporation-Roofing
Address/Phone/Email	20 Moores Road Malvern, PA 19355 (610) 893-5400 mark.d.harner@saint-gobain.com
Authorized Signature	Mark Harner mark.d.harner@saint-gobain.com
Technical Representative	Mark D. Harner
Address/Phone/Email	18 Moores Road Malvern, PA 19355 (610) 651-5847 Mark.D.Harner@saint-gobain.com
Quality Assurance Representative	
Address/Phone/Email	
Category	Roofing
Subcategory	Asphalt Shingles
Compliance Method	Evaluation Report from a Florida Registered Architect or a Licensed Florida Professional Engineer Evaluation Report - Hardcopy Received
Florida Engineer or Architect Name who developed the Evaluation Report	Robert Nieminen
Florida License	PE-59166
Quality Assurance Entity	UL LLC
Quality Assurance Contract Expiration Date	03/09/2020
Validated By	John W. Knezevich, PE ✓ Validation Checklist - Hardcopy Received
Certificate of Independence	<a href="#">FL5444 R13 COI 2018 01 COI NIEMINEN.pdf</a>
Referenced Standard and Year (of Standard)	<b>Standard</b> ASTM D3161 2016 ASTM D3462 2010 ASTM D7158 2011
Equivalence of Product Standards Certified By	
Sections from the Code	

Product Approval Method Method 1 Option D  
 Date Submitted 01/24/2018  
 Date Validated 01/29/2018  
 Date Pending FBC Approval 01/30/2018

**Summary of Products**

FL #	Model, Number or Name	Description
5444.1	CertainTeed Asphalt Roof Shingles	3-tab, 4-tab, strip (no-cut-outs), laminated and architectural asphalt roof shingles
<b>Limits of Use</b> <b>Approved for use in HVHZ:</b> No <b>Approved for use outside HVHZ:</b> Yes <b>Impact Resistant:</b> N/A <b>Design Pressure:</b> N/A <b>Other:</b> Refer to ER Section 5 for Limits of Use		<b>Installation Instructions</b> <a href="#">FL5444 R13 II 2018 01 FINAL ER CERTAINTEED ASPHALT SHINGLES FL5444-R13.pdf</a> Verified By: Robert Nieminen, PE PE-59166 Created by Independent Third Party: Yes <b>Evaluation Reports</b> <a href="#">FL5444 R13 AF 2018 01 FINAL ER CERTAINTEED ASPHALT SHINGLES FL5444-R13.pdf</a> Created by Independent Third Party: Yes



Contact Us :: [2601 Blair Stone Road, Tallahassee FL 32399](#) Phone: 850-487-1824

The State of Florida is an AA/EEO employer. [Copyright 2007-2013 State of Florida](#). :: [Privacy Statement](#) :: [Accessibility Statement](#) :: [Refund Statement](#)

Under Florida law, email addresses are public records. If you do not want your e-mail address released in response to a public-records request, do not send electronic mail to this entity. Instead, contact the office by phone or by traditional mail. If you have any questions, please contact 850.487.1395. \*Pursuant to Section 455.275(1), Florida Statutes, effective October 1, 2012, licensees licensed under Chapter 455, F.S. must provide the Department with an email address if they have one. The emails provided may be used for official communication with the licensee. However email addresses are public record. If you do not wish to supply a personal address, please provide the Department with an email address which can be made available to the public. To determine if you are a licensee under Chapter 455, F.S., please click [here](#).



Credit Card  
**Safe**





[BCIS Home](#)
[Log In](#)
[User Registration](#)
[Hot Topics](#)
[Submit Surcharge](#)
[Stats & Facts](#)
[Publications](#)
[FBC Staff](#)
[BCIS Site Map](#)
[Links](#)
[Search](#)



**Product Approval**  
USER: Public User

[Product Approval Menu](#) > 
 [Product or Application Search](#) > 
 [Application List](#) > 
 **Application Detail**

OFFICE OF THE SECRETARY

FL #	FL21841-R2						
Application Type	Revision						
Code Version	2017						
Application Status	Approved						
Comments							
Archived							
Product Manufacturer	CertainTeed Corporation-Roofing						
Address/Phone/Email	20 Moores Road Malvern, PA 19355 (610) 893-5400 mark.d.harner@saint-gobain.com						
Authorized Signature	Mark Harner mark.d.harner@saint-gobain.com						
Technical Representative	Mark D. Harner						
Address/Phone/Email	18 Moores Road Malvern, PA 19355 (610) 651-5847 Mark.D.Harner@saint-gobain.com						
Quality Assurance Representative							
Address/Phone/Email							
Category	Roofing						
Subcategory	Underlayments						
Compliance Method	Evaluation Report from a Florida Registered Architect or a Licensed Florida Professional Engineer Evaluation Report - Hardcopy Received						
Florida Engineer or Architect Name who developed the Evaluation Report	Robert Nieminen						
Florida License	PE-59166						
Quality Assurance Entity	QAI Laboratories						
Quality Assurance Contract Expiration Date	01/01/2023						
Validated By	John W. Knezevich, PE ✓ Validation Checklist - Hardcopy Received						
Certificate of Independence	<a href="#">FL21841_R2_COI_2017_01_COI_Nieminen.pdf</a>						
Referenced Standard and Year (of Standard)	<table border="0"> <thead> <tr> <th><b>Standard</b></th> <th><b>Year</b></th> </tr> </thead> <tbody> <tr> <td>ASTM D1970 (tear)</td> <td>2015</td> </tr> <tr> <td>ASTM D226 (physicals)</td> <td>2009</td> </tr> </tbody> </table>	<b>Standard</b>	<b>Year</b>	ASTM D1970 (tear)	2015	ASTM D226 (physicals)	2009
<b>Standard</b>	<b>Year</b>						
ASTM D1970 (tear)	2015						
ASTM D226 (physicals)	2009						
Equivalence of Product Standards Certified By							
Sections from the Code							



EXTERIOR RESEARCH & DESIGN, LLC.

Certificate of Authorization #9503  
353 CHRISTIAN STREET, UNIT #13  
OXFORD, CT 06478  
(203) 262-9245

**EVALUATION REPORT**

**CertainTeed Corporation**  
20 Moores Road  
Malvern, PA 19355  
**(610) 651-5847**

**Evaluation Report 13500.02.17-R2**  
**FL21841-R2**  
**Date of Issuance: 02/10/2017**  
**Revision 2: 09/05/2017**

**SCOPE:**

This Evaluation Report is issued under **Rule 61G20-3** and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for use of the product under the Florida Building Code and Florida Building Code, Residential Volume. The products described herein have been evaluated for compliance with the **6<sup>th</sup> Edition (2017) Florida Building Code** sections noted herein.

**DESCRIPTION: RoofRunner™ High Performance Synthetic Roofing Underlayment**

**LABELING:** Labeling shall be in accordance with the requirements the Accredited Quality Assurance Agency noted herein.

**CONTINUED COMPLIANCE:** This Evaluation Report is valid until such time as the named product(s) changes, the referenced Quality Assurance documentation changes, or provisions of the Code that relate to the product change. Acceptance of this Evaluation Report by the named client constitutes agreement to notify Robert Nieminen, P.E. if the product changes or the referenced Quality Assurance documentation changes. Trinity|ERD requires a complete review of this Evaluation Report relative to updated Code requirements with each Code Cycle.


**ADVERTISEMENT:** The Evaluation Report number preceded by the words "Trinity|ERD Evaluated" may be displayed in advertising literature. If any portion of the Evaluation Report is displayed, then it shall be done in its entirety.

**INSPECTION:** Upon request, a copy of this entire Evaluation Report shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This Evaluation Report consists of pages 1 through 3.

**Prepared by:**

**Robert J.M. Nieminen, P.E.**  
*Florida Registration No. 59166, Florida DCA ANE1983*



The facsimile seal appearing was authorized by Robert Nieminen, P.E. on 09/05/2017. This does not serve as an electronically signed document.

**CERTIFICATION OF INDEPENDENCE:**

1. Trinity|ERD does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. Trinity|ERD is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have nor will acquire, a financial interest in any company manufacturing or distributing products for which the evaluation reports are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither Trinity|ERD nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this Evaluation Report, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

**ROOFING COMPONENT EVALUATION:**
**1. SCOPE:**
**Product Category:** Roofing

**Sub-Category:** Underlayment

**Compliance Statement:** RoofRunner™ High Performance Synthetic Roofing Underlayment, as produced by CertainTeed Corporation, has demonstrated compliance with the following sections of the 6<sup>th</sup> Edition (2017) Florida Building Code through testing in accordance with applicable sections of the following Standards. Compliance is subject to the Installation Requirements and Limitations / Conditions of Use set forth herein.

**2. STANDARDS:**

<u>Section</u>	<u>Properties</u>	<u>Standard</u>	<u>Year</u>
1507.2.3 / 1507.1.1	Unrolling, Breaking Strength, Pliability	ASTM D226	2009
1507.1.1	Tear strength	ASTM D1970	2015

**3. REFERENCES:**

<u>Entity</u>	<u>Examination</u>	<u>Reference</u>	<u>Date</u>
ERD (TST6049)	Tear strength	CTR-SC16080.17	07/31/2017
QAI (TST9808)	Physical Properties, AC188	RJ3502P-1	11/05/2014
QAI (QUA7628)	Traceability/Inspections	Service Confirmation	02/09/2017

**4. PRODUCT DESCRIPTION:**

4.1 **RoofRunner™** is a synthetic polymer-based scrim-reinforced underlayment designed for use on roof decks as a water-resistant layer beneath asphalt roofing shingles; meets ASTM D226 physical property requirements and ASTM D1970 tear strength per the **Exception of FBC 1507.1.1**. **RoofRunner™** consists of a woven polyolefin base with a layer of nonwoven polyolefin sheet and a polymer coating on the back side. **RoofRunner™** is available in rolls 48-inch x 250-ft; nominal unit weight of 2.25 lbs/square.

**5. LIMITATIONS:**

5.1 This is a building code evaluation. Neither Trinity|ERD nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this Evaluation Report, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

5.2 This Evaluation Report is not for use in FBC HVHZ jurisdictions.

5.3 Fire Classification is not part of this Evaluation Report; refer to current Approved Roofing Materials Directory or test report from accredited testing/listing agency for fire ratings of this product.

5.4 **RoofRunner™** may be used with any prepared roof cover where the product is specifically referenced within FBC approval documents. If not listed, a request may be made to the Authority Having Jurisdiction for approval based on this evaluation combined with supporting data for the prepared roof covering.

5.5 **RoofRunner™** shall not be installed on roof slopes below 2:12.

**5.6 Allowable roof covers:**

TABLE 1: ROOF COVER OPTIONS						
Underlayment	Asphalt Shingles	Nail-On Tile	Foam-On Tile	Metal	Wood Shakes & Shingles	Slate
RoofRunner™	Yes	No	No	No	No	No

**5.7 Exposure Limitations:**

CertainTeed recommends primary roofing be installed within 48 hours of underlayment installation for re-roof applications or within 10-days of underlayment installation for new construction applications.

**6. INSTALLATION:**

- 6.1 **RoofRunner™ High Performance Synthetic Roofing Underlayment** shall be installed in accordance with **CertainTeed Corporation** published installation instructions subject to the Limitations set forth in Section 5 herein and the specifics noted below.
- 6.2 Install in compliance with the requirements for ASTM D226 underlayment in **FBC 1507.1.1**, taking into account the wider sheet-width of **RoofRunner™** for double-layer applications.
- 6.3 Re-fasten any loose decking panels, and check for protruding nail heads. Sweep the substrate thoroughly to remove any dust and debris prior to application.
- 6.4 Corrosion resistant fasteners shall be plastic cap nails with minimum 1-inch diameter head. **Do not use staples.** Ensure fasteners are installed at 90 degree angle to the deck with flush contact between the plastic cap or metal cap and the upper surface of the underlayment. Fasteners shall be of sufficient length to penetrate through the underside of plywood or OSB decks, or minimum ¾-inch embedment into dimensional lumber / tongue-and-groove wood decks.
- 6.5 Install a leak barrier of ASTM D1970, such as **CertainTeed WinterGuard (FL11288)**, or equal holding Florida Statewide Product Approval at vulnerable leak areas, including but not limited to eaves, valleys, rakes, skylights and dormers. At eaves and valleys, install the leak barrier prior to installation of **RoofRunner™**. Along the rake, install **RoofRunner™**, leaving 6 to 8-inch of the deck exposed, and then install the leak barrier over the **RoofRunner™** and exposed decking. At other areas, install the leak barrier over the **RoofRunner™**.
- 6.6 Single Layer; Roof Slope > 4:12:  
Starting at the eave, lay printed-side up and fasten at the circular targets printed on the top surface; 15-inch o.c. vertically and 12-inch o.c. horizontally (parallel to eaves). On vertical side/end laps install 8 fasteners equally spaced at 6-inch o.c. centered in the lap to hold the underlayment in place. Continue upslope in a similar manner, maintaining minimum 3-inch wide horizontal and minimum 6-inch wide vertical laps, and fasten as noted above. Offset vertical end laps from course to course at least 3 feet.
- 6.7 Double Layer; 2:12 < Roof Slope < 4:12:  
Starting at the eave, lay a 25.5-inch wide starter strip, printed-side up and fastened to hold in place. Then install a full 48-inch wide sheet, printed-side up, over the starter strip and fasten at the circular targets printed on the top surface; 15-inch o.c. vertically and 12-inch o.c. horizontally (parallel to eaves). On vertical side/end laps install 8 fasteners equally spaced at 6-inch o.c. centered in the lap to hold the underlayment in place. Continue upslope in a similar manner, maintaining minimum 25.5-inch wide horizontal laps (resulting in maximum 22.5-inch exposure) and minimum 12-inch wide vertical laps, and fasten as noted above. Offset vertical end laps from course to course at least 3 feet. Offset vertical end laps from course to course at least 3 feet.
- 6.8 **RoofRunner™** may not be used in any exposed application, including but not limited to crickets, exposed valleys or exposed roof to wall details.

**7. BUILDING PERMIT REQUIREMENTS:**

As required by the Building Official or Authority Having Jurisdiction in order to properly evaluate the installation of this product.

**8. MANUFACTURING PLANTS:**

Dadra, India

**9. QUALITY ASSURANCE ENTITY:**

Quality Auditing Institute, Ltd. – QUA7628; (604) 527-8378, [mlansdowne@qai.org](mailto:mlansdowne@qai.org)

- END OF EVALUATION REPORT -



**NEMO|etc.**

Certificate of Authorization #32455  
353 Christian Street, Unit #13  
Oxford, CT 06478  
(203) 262-9245

ENGINEER

EVALUATE

TEST

CONSULT

CERTIFY

**EVALUATION REPORT**

**CertainTeed Corporation**  
20 Moores Road  
Malvern, PA 19355  
**(610) 651-5847**

**Evaluation Report 3532.09.05-R14**  
**FL5444-R13**  
**Date of Issuance: 09/22/2005**  
**Revision 14: 01/24/2018**

**SCOPE:**

This Evaluation Report is issued under **Rule 61G20-3** and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for use of the product under the Florida Building Code and Florida Building Code, Residential Volume. The products described herein have been evaluated for compliance with the **6<sup>th</sup> Edition (2017) Florida Building Code** sections noted herein.

**DESCRIPTION: CertainTeed Asphalt Roof Shingles.**

**LABELING:** Labeling shall be in accordance with the requirements of the Accredited Quality Assurance Agency noted herein and **FBC 1507.2.7.1 / R905.2.6.1**

**CONTINUED COMPLIANCE:** This Evaluation Report is valid until such time as the named product(s) changes, the referenced Quality Assurance documentation changes, or provisions of the Code that relate to the product change. Acceptance of this Evaluation Report by the named client constitutes agreement to notify Robert Nieminen, P.E. of any changes to the product(s), the Quality Assurance or the production facility location(s). NEMO|etc. requires a complete review of this Evaluation Report relative to updated Code requirements with each Code Cycle.

**ADVERTISEMENT:** The Evaluation Report number preceded by the words "NEMO|etc. Evaluated" may be displayed in advertising literature. If any portion of the Evaluation Report is displayed, then it shall be done in its entirety.

**INSPECTION:** Upon request, a copy of this entire Evaluation Report shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This Evaluation Report consists of pages 1 through 13.

**Prepared by:**

**Robert J.M. Nieminen, P.E.**  
*Florida Registration No. 59166, Florida DCA ANE1983*



The facsimile seal appearing was authorized by Robert Nieminen, P.E. on 01/24/2018. This does not serve as an electronically signed document.

**CERTIFICATION OF INDEPENDENCE:**

1. NEMO|etc. does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. NEMO|etc. is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have nor will acquire, a financial interest in any company manufacturing or distributing products for which the evaluation reports are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither NEMO|etc. nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this Evaluation Report, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.



**ROOFING SYSTEMS EVALUATION:**

**1. SCOPE:**

**Product Category:** Roofing  
**Sub-Category:** Asphalt Shingles

**Compliance Statement:** CertainTeed Asphalt Roof Shingles, as produced by CertainTeed Corporation, have demonstrated compliance with the following sections of the 6<sup>th</sup> Edition (2017) Florida Building Code and 6<sup>th</sup> Edition (2017) Florida Building Code, Residential Volume through testing in accordance with the following Standards. Compliance is subject to the Installation Requirements and Limitations / Conditions of Use set forth herein.

**2. STANDARDS:**

<u>Section</u>	<u>Property</u>	<u>Standard</u>	<u>Year</u>
1507.2.5, R905.2.4	Physical Properties	ASTM D3462	2010
1507.2.7.1, R905.2.6.1	Wind Resistance	ASTM D3161	2016
1507.2.7.1, R905.2.6.1	Wind Resistance	ASTM D7158	2011

**3. REFERENCES:**

<u>Entity</u>	<u>Examination</u>	<u>Reference</u>	<u>Date</u>
UL (TST 1740)	ASTM D3161	94NK9632	05/15/1998
UL (TST 1740)	ASTM D3161	99NK26506	11/23/1999
UL (TST 1740)	ASTM D3161	03CA12702	05/27/2003
UL (TST 1740)	ASTM D3161	03CA12702	06/16/2003
UL (TST 1740)	ASTM D3161	03NK29847	10/03/2003
UL (TST 1740)	ASTM D3161	04CA11329	05/24/2004
UL (TST 1740)	ASTM D3161	04CA32986	12/03/2004
UL (TST 1740)	ASTM D3161	05NK07049	04/15/2005
UL (TST 1740)	ASTM D3161	05NK16778	05/12/2005
UL (TST 1740)	ASTM D3161	05CA16778	05/12/2005
UL (TST 1740)	ASTM D3161	05NK14836	05/22/2005
UL (TST 1740)	ASTM D3161	05NK22800	06/22/2005
UL (TST 1740)	ASTM D3462	R684	09/21/2005
UL (TST 1740)	ASTM D7158	05NK08037	06/28/2006
UL (TST 1740)	ASTM D3161 & D3462	09CA28873	07/23/2009
UL (TST 1740)	ASTM D3462	10CA41303	10/07/2010
UL (TST 1740)	ASTM D3161	10CA41303	10/08/2010
UL (TST 1740)	ASTM D7158	10CA41303	10/27/2010
UL (TST 1740)	ASTM D3161 & D3462	10CA44960	11/11/2010
UL LLC (TST 9628)	ASTM D3161, D3462 & D7158	13CA32897	11/21/2013
UL LLC (TST 9628)	ASTM D3161, D3462	TFWZ.R684	04/22/2014
UL LLC (TST 9628)	ASTM D7158	TGAH.R684	04/22/2014
UL LLC (TST 9628)	ASTM D3161 & D3462	4786334434	09/16/2014
UL LLC (TST 9628)	ASTM D3161 & D3462	4786570826	02/12/2015
UL LLC (TST 9628)	ASTM D3161, D3462 & D7158	4786570717	12/16/2015
UL LLC (TST 9628)	ASTM D3161 & D3462	4787195678	02/09/2016
UL LLC (TST 9628)	ASTM D3161, D3462 & D7158	4787380356	10/26/2016
UL LLC (TST 9628)	ASTM D3462	4787380357	10/13/2016
UL LLC (TST 9628)	ASTM D7158	4787380357	11/08/2016
UL LLC (TST 9628)	ASTM D3161	4787380357	11/09/2016
UL LLC (TST 9628)	ASTM D3161, D3462 & D7158	4787586427	01/25/2017
UL LLC (TST 9628)	ASTM D3161 & D3462	4788042412	11/15/2017
UL LLC (QUA 9625)	Quality Control	Service Confirmation	Exp. 03/09/2020

#### 4. PRODUCT DESCRIPTION:

##### 4.1 Asphalt Shingles:

- 4.1.1 **CT20™, XT™ 25, XT™ 30 and XT™ 30 IR** are fiberglass reinforced, 3-tab asphalt roof shingles.
- 4.1.2 **Arcadia™, Belmont®, Belmont® IR, Carriage House Shingle®, Grand Manor Shingle®, Landmark™, Landmark™ IR, Landmark™ Pro, Landmark™ Premium, Landmark™ TL, Landmark™ Solaris and Landmark™ Solaris IR** are fiberglass reinforced, laminated asphalt roof shingles.
- 4.1.3 **NorthGate™** is a fiberglass reinforced, laminated, SBS modified bitumen roof shingle.
- 4.1.4 **Presidential Shake™, Presidential Shake™ IR, Presidential Shake TL™ and Presidential Solaris™** are fiberglass reinforced, architectural asphalt roof shingles.
- 4.1.5 **Hatteras™, Highland Slate™ and Highland Slate™ IR** are fiberglass reinforced, 4-tab asphalt roof shingles.
- 4.1.6 **Patriot™** is a fiberglass reinforced asphalt roof strip-shingle (with no cut-outs) providing a laminated appearance through an intermittent shadow line with contrasting blend drops for color definition.

##### 4.2 Hip & Ridge Shingles:

- 4.2.1 **Presidential Accessory, Accessory for Hatteras, Shingle Ridge™, Shadow Ridge™, Cedar Crest™, Cedar Crest™ IR, NorthGate Ridge and NorthGate Accessory** are fiberglass reinforced accessory shingles for hip and ridge installation.

##### 4.3 Accessory Starter Strips:

- 4.3.1 **SwiftStart® Starter Shingle** is a starter strip for asphalt roof shingles. Its overall size of 15-1/4" x 38-3/4" yields two (2) 7-5/8" x 38-3/4" starter pieces per shingle.
- 4.4 Any of the above listed shingles may be produced in AR (algae resistant) versions.

#### 5. LIMITATIONS:

- 5.1 This is a building code evaluation. Neither NEMO|etc. nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this Evaluation Report, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.
- 5.2 This Evaluation Report is not for use within FBC HVHZ jurisdictions.
- 5.3 Fire Classification is not part of this Evaluation Report; refer to current Approved Roofing Materials Directory for fire ratings of this product.
- 5.4 Wind Classification:
  - 5.4.1 All shingles noted herein are Classified in accordance with **FBC Tables 1507.2.7.1 and R905.2.6.1 to ASTM D3161, Class F** and/or **ASTM D7158, Class H**, indicating the shingles are acceptable for use in all wind zones up to  $V_{asd} = 150$  mph ( $V_{ult} = 194$  mph). Refer to Section 6 for installation requirements to meet this wind rating.
  - 5.4.2 **Presidential Accessory, Accessory for Hatteras, Shingle Ridge, Shadow Ridge, Cedar Crest, NorthGate Ridge and NorthGate Accessory hip & ridge shingles** have been evaluated in accordance with **ASTM D3161, Class F**. All except **NorthGate Ridge and NorthGate Accessory** require use of **BASF Sonolastic NP 1 adhesive** or **Henkel PL® Polyurethane Roof & Flashing Sealant**, applied as specified in manufacturer's application instructions, for use in wind zones up to  $V_{asd} = 150$  mph ( $V_{ult} = 194$  mph). Refer to Section 6 for installation requirements to meet this wind rating.
  - 5.4.3 **SwiftStart® Starter Shingle** has been evaluated in accordance with **ASTM D3161, Class F**. Refer to Section 6 for installation requirements to meet this wind rating.
  - 5.4.4 Classification by **ASTM D7158** applies to **exposure category B or C** and a **building height of 60 feet or less**. Calculations by a qualified design professional are required for conditions outside these limitations. Contact the shingle manufacturer for data specific to each shingle.


- 5.4.4.1 **Analysis in accordance with ASTM D7158** indicates the measured uplift resistance ( $R_T$ ) for the CertainTeed asphalt Roof shingles listed in Section 4.1 through 4.6 (*except Presidential Solaris™*) exceeds the calculated uplift force ( $F_T$ ) at a maximum design wind speed of  $V_{asd} = 150$  mph ( $V_{ult} = 194$  mph) for **residential buildings** located in **Exposure D conditions** with **no topographical variations (flat terrain)** having a **mean roof height less than or equal to 60 feet**. The shingles are permissible under Code for installation in these conditions using the installation procedures detailed in this Evaluation Report and CertainTeed minimum requirements, subject to minimum codified fastening requirements established within any local jurisdiction, which shall take precedence.
- 5.5 All products in the roof assembly shall have quality assurance audits in accordance with **FAC Rule 61G20-3**.

**6. INSTALLATION:**

- 6.1 Roof deck, slope, underlayment and fasteners shall comply with **FBC 1507.2 / R905.2** and the shingle manufacturer's minimum requirements.
- 6.1.1 Underlayment shall be acceptable to **CertainTeed Corporation** and shall hold current Florida Statewide Product Approval, or be Locally Approved per **Rule 61G20-3**, per **FBC Sections 1507.2.3, 1507.2.4 or R905.2.3**.
- 6.2 Installation of asphalt shingles shall comply with the **CertainTeed Corporation** current published instructions, using minimum four (4) nails per shingle in accordance with **FBC 1507.2.7 or Section R905.2.6** and the minimum requirements herein.
- 6.2.1 Fasteners shall be in accordance with manufacturer's published requirements, but not less than **FBC 1507.2.6 or R905.2.5**. Staples are not permitted.
- 6.2.2 Where the roof slope exceeds 21 units vertical in 12 units horizontal, use the "Steep Slope" directions.
- 6.3 CertainTeed asphalt shingles are acceptable for use in reroof (tear-off) or recover applications, subject to the limitations set forth in **FBC Section 1511 or R908** and CertainTeed published installation instructions.

**6.4 SWIFTSTART® STARTER SHINGLE:**


**Fastening: Use four nails, located as shown below**

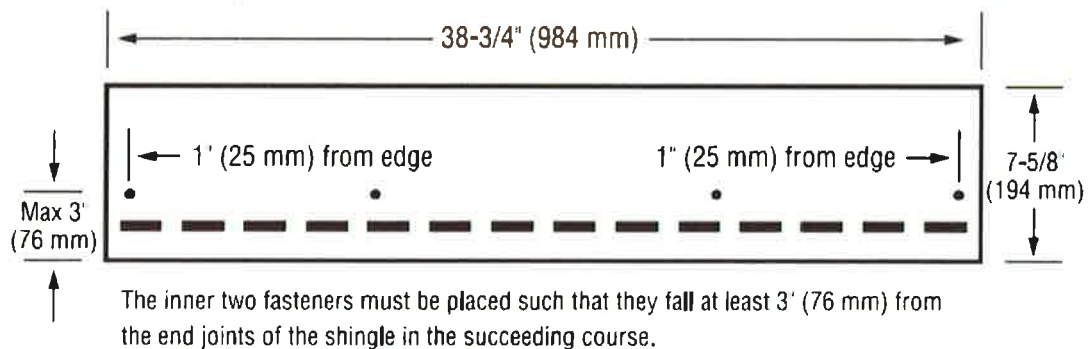

**6.5 CT20™, XT™ 25, XT™ 30, XT™ 30 IR:**

**LOW AND STANDARD SLOPE**

**ENGLISH**

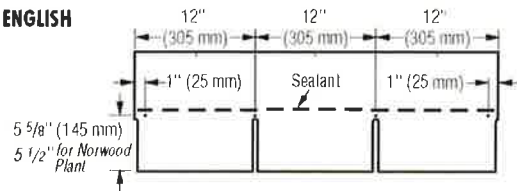

**METRIC**


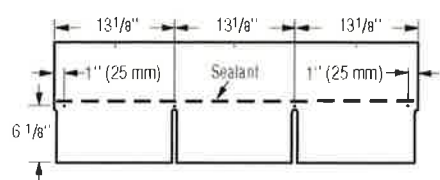


Figure 11-3: Use four nails for every full shingle.

**STEEP SLOPE**

Use **four** nails and six spots of asphalt roofing cement\* for every full shingle (Figure 11-4). Asphalt roofing cement meeting ASTM D4586 Type II is suggested.

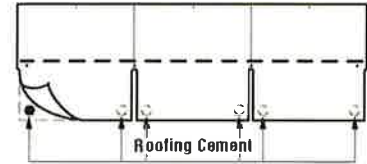

Apply 1" (25 mm) spots of asphalt roofing cement under each tab corner.

Figure 11-4: Use four nails and six spots of asphalt cement on steep slopes.

**\*CAUTION:** Excessive use of roofing cement can cause shingles to blister.

**6.5.1 Hip & Ridge for CT20™, XT™ 25, XT™ 30, XT™ 30 IR: Cut Shingles**

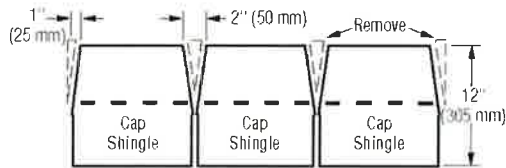


Figure 11-24: Cut tabs, then trim back to make cap shingles (English dimensions shown).

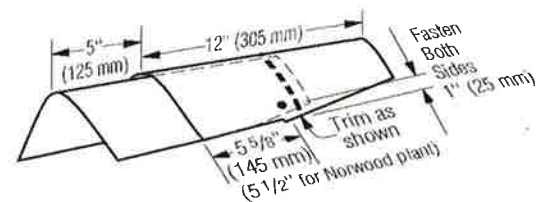


Figure 11-25: Installation of caps along the hips and ridges.

6.5.1.1 For ASTM D3161, Class F performance use BASF "Sonolastic® NP1™" adhesive or Henkel "PL® Polyurethane Roof & Flashing Sealant", in accordance with CertainTeed requirements.

**6.6 ARCADIA™:**

**LOW AND STANDARD SLOPE**

Use **SIX** nails for every full shingle located as shown below.

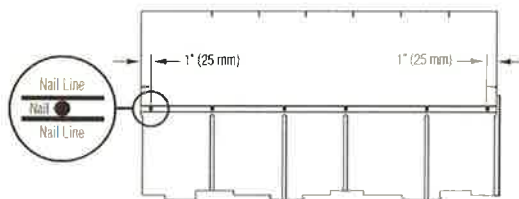


Figure 2: Use six nails for every full shingle.

**STEEP SLOPE**

Use **SIX** nails and **FOUR** spots of asphalt roofing cement for every full shingle as shown below. Apply asphalt roofing cement 1" (25 mm) from edge of shingle. Asphalt roofing cement meeting ASTM D 4586 Type II is suggested.


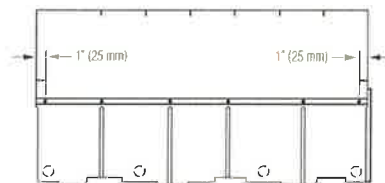


Figure 3: Use six nails and four spots of asphalt roofing cement on steep slopes.

6.6.1 **Hip & Ridge for Arcadia™: Cedar Crest™, Cedar Crest™ IR**

Use two (2), minimum 1¾-inch long fasteners per shingle. For the starter shingle, place fastener 1-inch from each side edge and about 2-inch up from the starter shingle’s exposed butt edge, ensuring minimum ¾-inch embedment into the deck, or full penetration through the deck. For each full Cedar Crest shingle, place fasteners 8-5/8-inch up from its exposed butt edge and 1-inch from each side edge.


For ASTM D3161, Class F performance use BASF “**Sonolastic® NP1™**” adhesive or Henkel “**PL® Polyurethane Roof & Flashing Sealant**”, in accordance with CertainTeed requirements, to **hand-seal Cedar Crest shingles**. Apply NP 1 or PL adhesive from the middle of the shingle’s raised overlay on the top piece and extending approximately 4-inch along the sides of the headlap along a line ¾ to 1-inch from each side of the shingle’s headlap. Immediately align and apply the overlying shingle, gently pressing tab sides into the adhesive, and install nails. To secure the other side, apply a 1-inch diameter spot of NP 1 or PL adhesive between the shingle layers.

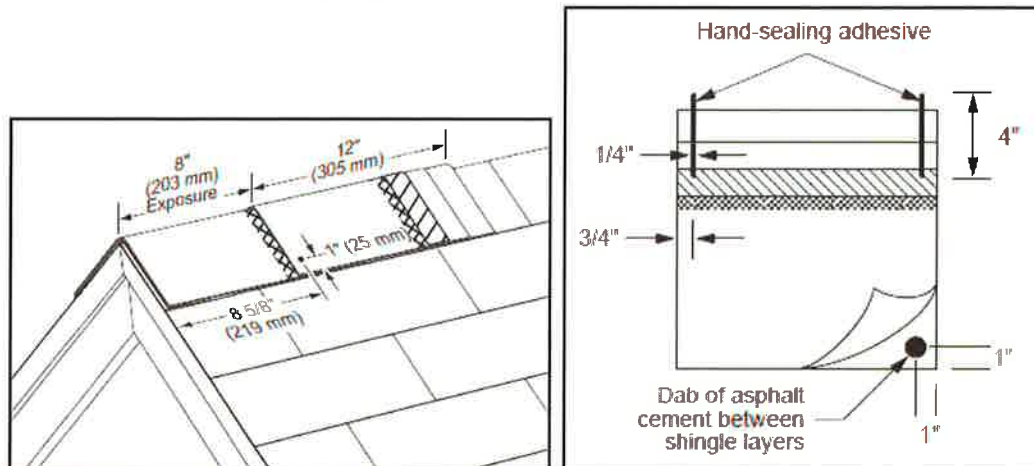

**6.7 BELMONT® OR BELMONT® IR:**


**Low and Standard Slope (2:12 to 21:12):**

Use FIVE nails for every full Belmont shingle, located as shown below.

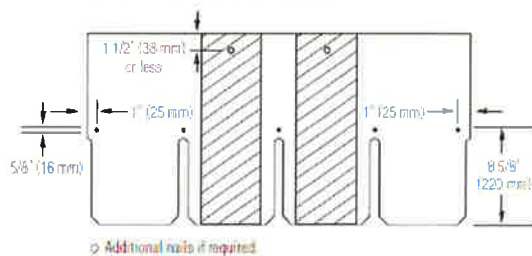

**Steep Slope (greater than 21:12):**

Use SEVEN nails and EIGHT spots of asphalt roofing cement\*\* for every full Belmont shingle. Apply asphalt roofing cement 1 inch (25 mm) from edge of shingle. See below. Asphalt roofing cement meeting ASTM D4586 Type II is suggested.

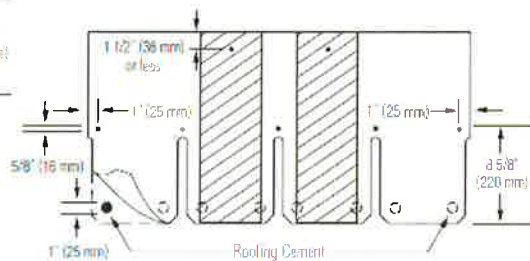

6.7.1 **Hip & Ridge for Belmont® or Belmont® IR:**

6.7.1.1 **Option 1:** For Belmont®, refer to instructions herein for Cedar Crest™ or Cedar Crest™ IR hip and ridge shingles. For Belmont® IR, refer to instructions herein for Cedar Crest™ IR hip and ridge shingles.

6.7.1.2 **Option 2:** For Belmont®: Shangle® Ridge

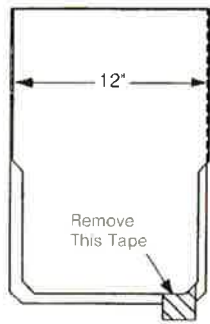


Figure 17-18: Shangle® Ridge.

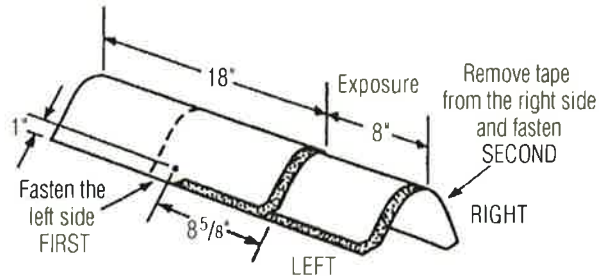


Figure 17-19: Installation of Shangle® Ridge shingles on hips and ridges.

6.7.1.3 For ASTM D3161, Class F performance use BASF “Sonolastic® NP1™” adhesive or Henkel “PL® Polyurethane Roof & Flashing Sealant”, in accordance with CertainTeed requirements.

**6.8 CARRIAGE HOUSE SHANGLE® AND GRAND MANOR SHANGLE®:**

**LOW AND STANDARD SLOPE**

Use five nails for every full Shangle.

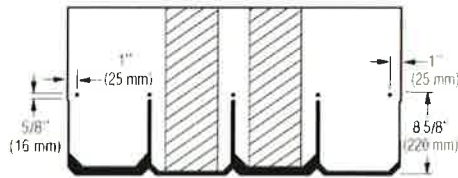


Figure 17-4: Use five nails for every full Grand Manor Shangle, Carriage House Shangle, or Centennial Slate

**STEEP SLOPE**

Use seven nails and three spots of asphalt roofing cement for every full Grand Manor Shangle. Use five nails and three spots of asphalt roofing cement for every full Carriage House Shangle and Centennial Slate. Apply asphalt roofing cement 1" (25 mm) from edge of shingle (Figure 17-5). Asphalt roofing cement meeting ASTM D4586 Type II is suggested.

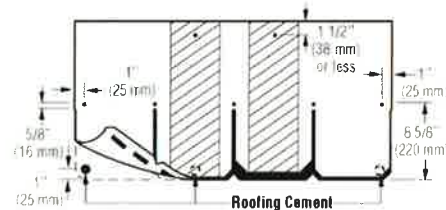



Figure 17-5: When installing Grand Manor Shingles on steep slopes, use seven nails and three spots of asphalt roofing cement.

6.8.1 **Hip & Ridge for Carriage House Shangle® and Grand Manor Shangle:** Refer to instructions herein for Shangle® Ridge hip and ridge shingles

6.9 LANDMARK™, LANDMARK™ IR, LANDMARK™ PRO, LANDMARK™ PREMIUM, LANDMARK™ TL, LANDMARK™ SOLARIS, LANDMARK™ SOLARIS IR, NORTHGATE:

LOW AND STANDARD SLOPE

METRIC DIMENSIONS

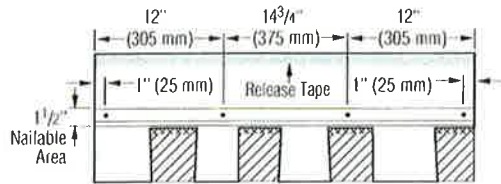

LANDMARK TL


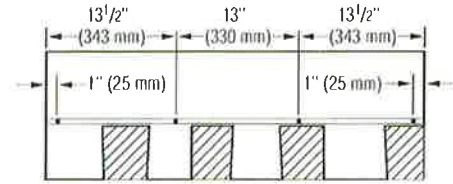


Figure 13-4: Use four nails for every full shingle.

NorthGate:

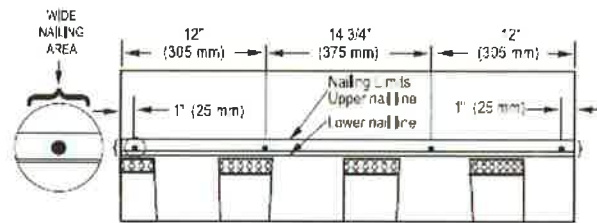


Nailing areas for low and standard slopes (from 2:12 to 21:12)  
Nail between upper & lower lines as shown above.

STEEP SLOPE

Use six nails and four spots of asphalt roofing cement for every full laminated shingle. See below. Asphalt roofing cement should meet ASTM D4586 Type II. Apply 1" spots of asphalt roofing cement under each corner and at about 12" to 13" in from each edge.

METRIC DIMENSIONS

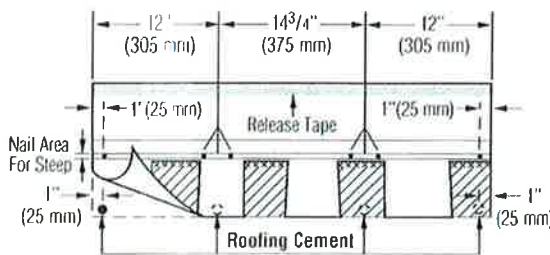

LANDMARK TL


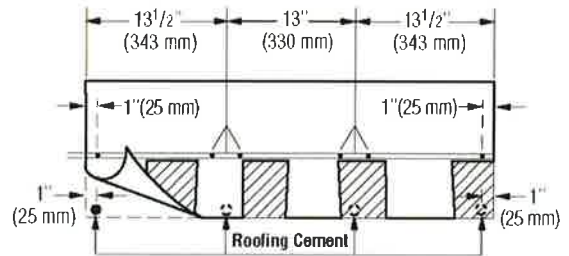



Figure 13-5: Use six nails and four spots of asphalt roofing cement on steep slopes.

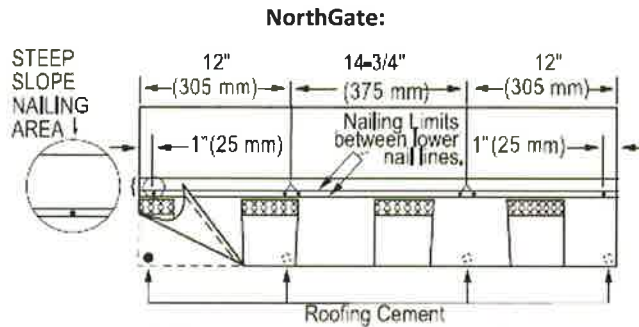

**Nailing areas for steep slopes (greater than 21:12) and "Storm-Nailing"**  
Nail between lower 2 nail lines as shown above.


6.9.1 **Hip & Ridge for Landmark™, Landmark™ IR, Landmark™ Pro, Landmark™ Premium, Landmark™ TL, Landmark™ Solaris, Landmark™ Solaris IR, NorthGate:**

6.9.1.1 **Option 1: Shadow Ridge™ or NothGate Accessory**

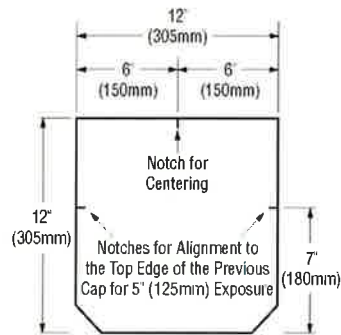


**English Dimension**

**Shadow Ridge™**

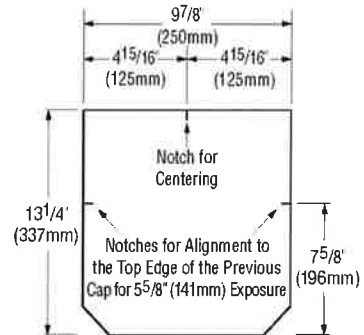


**Metric Dimension**

**Shadow Ridge™**

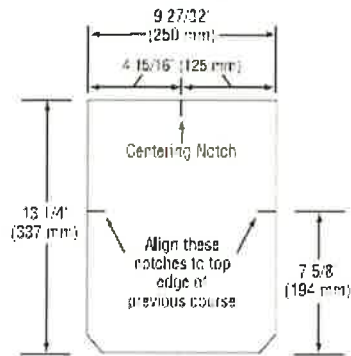

**NorthGate Ridge**

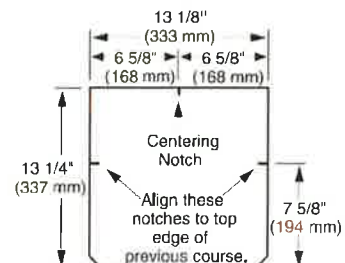

**NorthGate Accessory**



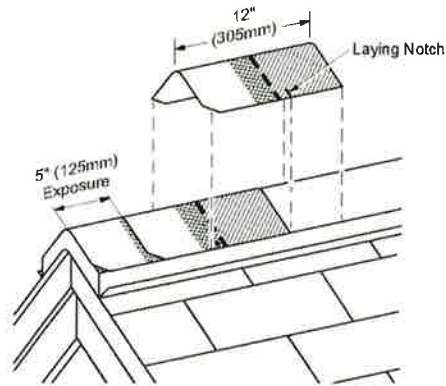


Figure 13-20: Use laying notches to center shingles on hips and ridges, and to locate the correct exposure.

- 6.9.1.2 For **ASTM D3161, Class F** performance use BASF “**Sonolastic® NP1™**” adhesive or Henkel “**PL® Polyurethane Roof & Flashing Sealant**”, in accordance with CertainTeed requirements.
- 6.9.1.3 **Option 2:** Refer to instructions herein for **Cedar Crest™, Cedar Crest™ IR** hip and ridge shingles.

## 6.10 PRESIDENTIAL SHAKE™, PRESIDENTIAL SHAKE™ IR, PRESIDENTIAL SHAKE TL™, PRESIDENTIAL SOLARIS™:

### LOW AND STANDARD SLOPE:

For low and standard slopes, use five nails for each full Presidential shingle as shown below.

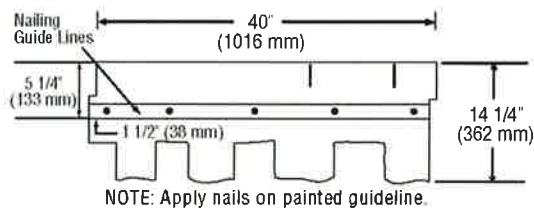


Figure 16-6: Fastening Presidential and Presidential TL Shake shingles on low and standard slopes.

### STEEP SLOPE:

For steep slopes, use nine nails for each full Presidential shingle and apply 1" diameter spots of asphalt roofing cement under each shingle tab. After applying 5 nails in between the nailing guide lines, apply 4 nails 1" above tab cutouts making certain tabs of overlying shingle cover nails.

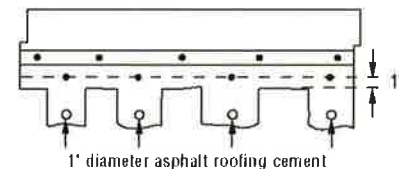


Figure 16-7: Fastening Presidential and Presidential TL Shake shingles on steep slopes.

## 6.10.1 Hip & Ridge for Presidential Shake™, Presidential Shake™ IR, Presidential Shake TL™, Presidential Solaris™:

### 6.10.1.1 Option 1: Presidential Accessory

#### PRESIDENTIAL ACCESSORY

Presidential accessory shingles can be used for covering hips and ridges. Apply shingles up to the ridge (expose no more than 7" from the bottom edge of the "tooth." Fasten each accessory with two fasteners. The fasteners must be 1 3/4" long or longer, so they penetrate either 3/4" into the deck or completely through the deck. Presidential accessory comes in two different sizes: Accessory produced in Birmingham, AL is 12" x 12"; Portland, OR produces 9 7/8" x 13 1/4" accessory.

- 6.10.1.2 For **ASTM D3161, Class F** performance use BASF “**Sonolastic® NP1™**” adhesive or Henkel “**PL® Polyurethane Roof & Flashing Sealant**”, in accordance with CertainTeed requirements.

6.10.1.3 **Option 2:** Refer to instructions herein for Cedar Crest™, Cedar Crest™ IR hip and ridge shingles.

**6.11 HATTERAS™:**

**LOW, STANDARD AND STEEP SLOPE:**

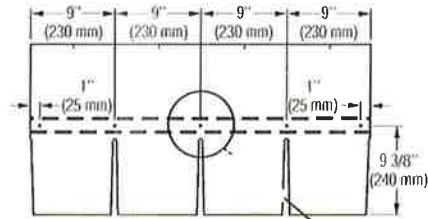


Figure 15-3: Fastening Hatteras Shingles on Low and Standard Slopes

For low and standard slopes, use five nails for each full Hatteras shingle as shown above.

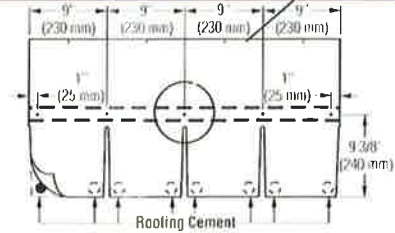


Figure 15-4: Fastening Hatteras Shingles on Steep Slopes

For steep slopes, use five nails and eight spots of asphalt roofing cement for each full Hatteras shingle as shown above. Apply 1" (25mm) diameter spots of roofing cement (ASTM D 4586 Type II suggested) under each tab corner. Press shingle into place; do not expose cement.

CAUTION: Too much roofing cement can cause shingles to blister.

**6.11.1 Hip & Ridge for Hatteras™:**

**6.11.1.1 Option 1:** Accessory for Hatteras


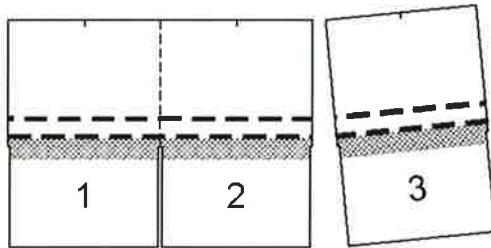


Figure 15-14: 18 three-piece units separate to make 54 Hatteras Accessory shingles.

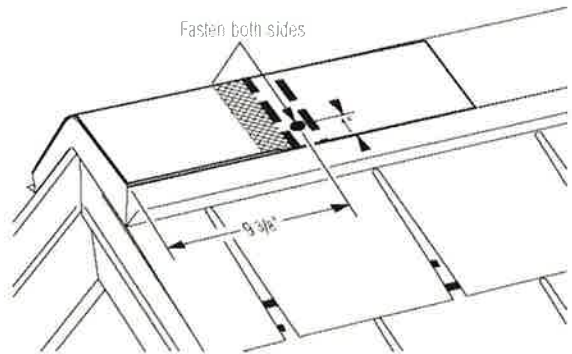

**6.11.1.2 Option 2:** Cut Hatteras Shingles

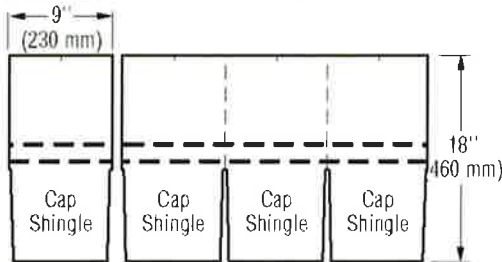


Figure 15-20: Cut Hatteras shingles to make cover cap.

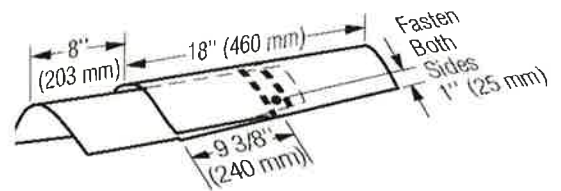


Figure 15-21: Installation of caps along hips and ridges.

6.11.1.3 For ASTM D3161, Class F performance use BASF "Sonolastic® NP1™" adhesive or Henkel "PL® Polyurethane Roof & Flashing Sealant", in accordance with CertainTeed requirements.

**6.12 HIGHLAND SLATE™, HIGHLAND SLATE™ IR:**

**LOW AND STANDARD SLOPE:**

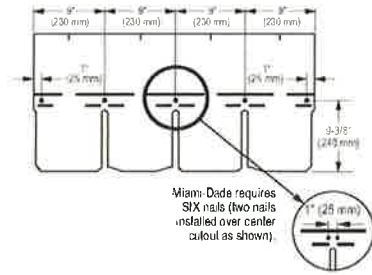


Figure 11-3: Use FIVE nails for every Highland Slate shingle.

**STEEP SLOPE:**

Use FIVE nails and EIGHT spots of asphalt roofing cement\* for each full Highland Slate shingle. For Miami-Dade, SIX nails are required. Apply 1" diameter spots of asphalt roofing cement under each tab corner. Asphalt roofing cement meeting ASTM D4586 Type II is suggested.

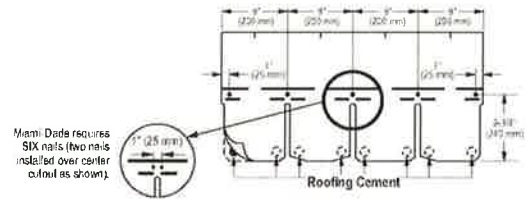


Figure 11-3A: Use FIVE nails and eight spots of asphalt roofing cement under each tab corner.


\*CAUTION: Excessive use of roofing cement can cause shingles to blister.

6.12.1 **Hip & Ridge for Highland Slate™, Highland Slate™ IR:** Refer to instructions herein for Cedar Crest™, Cedar Crest™ IR or Shangle Ridge™ hip and ridge shingles.

**6.13 PATRIOT™:**

**LOW AND STANDARD SLOPE**


Use FOUR nails for every full shingle located as shown below.

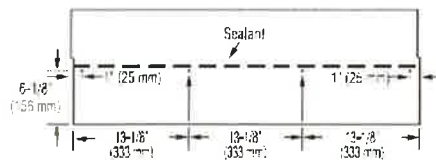

**STEEP SLOPE**

Use FOUR nails and four spots of asphalt roofing cement for every full shingle as shown below. Asphalt roofing cement meeting ASTM D4586 Type II is suggested. Apply 1" (25 mm) spots of asphalt roofing cement as shown.

CAUTION: Excessive use of roofing cement can cause shingles to blister.

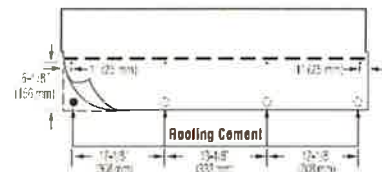

6.13.1 **Hip & Ridge for Patriot™:** Refer to instructions herein for Cedar Crest™, Cedar Crest™ IR, Shadow Ridge™, NorthGate or Shangle Ridge™ hip and ridge shingles.

**7. LABELING:**

- 7.1 Each unit shall bear a permanent label with the manufacturer's name, logo, city, state and logo of the Accredited Quality Assurance Agency noted herein.
- 7.2 Asphalt shingle wrappers shall indicate compliance with one of the required classifications detailed in FBC Table 1507.2.7.1 / R905.2.6.1.



**8. BUILDING PERMIT REQUIREMENTS:**

As required by the Building Official or Authority Having Jurisdiction in order to properly evaluate the installation of this product.

**9. MANUFACTURING PLANTS:**

Contact the named QA entity for information on which plants produce products covered by **Florida Rule 61G20-3** QA requirements.

**10. QUALITY ASSURANCE ENTITY:**

UL LLC – QUA9625; (414) 248-6409; karen.buchmann@us.ul.com

**- END OF EVALUATION REPORT -**



[HOME](#) [ABOUT DBPR](#) [DBPR DIVISIONS](#) [CONTACT DBPR](#)

[BCIS Home](#) [Log In](#) [User Registration](#) [Hot Topics](#) [Submit Surcharge](#) [Stats & Facts](#) [Publications](#) [FBC Staff](#) [BCIS Site Map](#) [Links](#) [Search](#)



**Product Approval**  
USER: Public User

[Product Approval Menu](#) > [Product or Application Search](#) > [Application List](#) > **Application Detail**



FL # FL2533-R19  
Application Type Revision  
Code Version 2017  
Application Status Approved

Comments  
Archived

Product Manufacturer CertainTeed Corporation-Roofing  
Address/Phone/Email 20 Moores Road  
Malvern, PA 19355  
(610) 893-5400  
mark.d.harner@saint-gobain.com

Authorized Signature Mark Harner  
mark.d.harner@saint-gobain.com

Technical Representative Mark D. Harner  
Address/Phone/Email 18 Moores Road  
Malvern, PA 19355  
(610) 651-5847  
Mark.D.Harner@saint-gobain.com

Quality Assurance Representative  
Address/Phone/Email

Category Roofing  
Subcategory Modified Bitumen Roof System

Compliance Method Evaluation Report from a Florida Registered Architect or a Licensed Florida Professional Engineer  
Evaluation Report - Hardcopy Received

Florida Engineer or Architect Name who developed the Evaluation Report Robert Nieminen  
Florida License PE-59166  
Quality Assurance Entity UL LLC  
Quality Assurance Contract Expiration Date 03/09/2020  
Validated By John W. Knezevich, PE  
✓ Validation Checklist - Hardcopy Received

Certificate of Independence [FL2533\\_R19\\_COI\\_2017\\_01\\_COI\\_Nieminen.pdf](#)

Referenced Standard and Year (of Standard)	Standard	Year
	ASTM D6162	2008
	ASTM D6163	2008
	ASTM D6164	2011
	ASTM D6222	2011
	ASTM D6509	2009
	FM 4470	2012
	FM 4474	2011

Equivalence of Product Standards

Certified By

Sections from the Code

Product Approval Method Method 1 Option D

Date Submitted 09/14/2017

Date Validated 09/15/2017

Date Pending FBC Approval 09/19/2017

Date Approved 12/12/2017

**Summary of Products**

FL #	Model, Number or Name	Description
2533.1	Flintlastic Modified Bitumen Roof Systems	Modified Bitumen Roof Systems
<b>Limits of Use</b> Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: N/A Design Pressure: +N/A/-635 Other: 1.) Refer to ER Section 5 for Limits of Use. 2.) The design pressure noted in this application relates to one specific system. Refer to the ER Appendix for all systems and max design pressures.		<b>Installation Instructions</b> <a href="#">FL2533 R19 II 2017 09 FINAL A1 ER CERTAINTEED MODBIT FL2533-R19.pdf</a> Verified By: Robert Nieminen, PE PE-59166 Created by Independent Third Party: Yes <b>Evaluation Reports</b> <a href="#">FL2533 R19 AE 2017 09 FINAL ER CERTAINTEED MODBIT FL2533-R19.pdf</a> Created by Independent Third Party: Yes



Contact Us :: [2601 Blair Stone Road, Tallahassee FL 32399](#) Phone: 850-487-1824

The State of Florida is an AA/EEO employer. [Copyright 2007-2013 State of Florida](#). :: [Privacy Statement](#) :: [Accessibility Statement](#) :: [Refund Statement](#)

Under Florida law, email addresses are public records. If you do not want your e-mail address released in response to a public-records request, do not send electronic mail to this entity. Instead, contact the office by phone or by traditional mail. If you have any questions, please contact 850.487.1395. \*Pursuant to Section 455.275(1), Florida Statutes, effective October 1, 2012, licensees licensed under Chapter 455, F.S. must provide the Department with an email address if they have one. The emails provided may be used for official communication with the licensee. However email addresses are public record. If you do not wish to supply a personal address, please provide the Department with an email address which can be made available to the public. To determine if you are a licensee under Chapter 455, F.S., please click [here](#).



Credit Card  
Safe





**APPENDIX 1: ATTACHMENT REQUIREMENTS FOR WIND UPLIFT RESISTANCE**

Table	Deck	Application	Type	Description	Page
1A	Wood	New or Reroof (Tear-Off)	A-2	Mech. Attached Anchor Sheet, Bonded Insulation, Bonded Roof Cover	5-6
1B	Wood	New, Reroof (Tear-Off) or Recover	B	Mech. Attached Base Insulation, Bonded Top Insulation, Bonded Roof Cover	7
1C	Wood	New, Reroof (Tear-Off) or Recover	C	Mech. Attached Insulation, Bonded Roof Cover	8-9
1D	Wood	New, Reroof (Tear-Off) or Recover	D	Insulated, Mech. Attached Base Sheet, Bonded Roof Cover	10-12
1E-1	Wood	New, Reroof (Tear-Off)	E	Non-insulated, Mech. Attached Base Sheet, Bonded Roof Cover	13-15
1E-2	Wood	New, Reroof (Tear-Off) or Recover	E	Non-insulated, Mech. Attached Base Sheet, Bonded Roof Cover	16-17
1F	Wood	New or Reroof (Tear-Off)	F	Non-insulated, Bonded Roof Cover	17
2A	Steel or Structural Concrete	New, Reroof (Tear-Off) or Recover	B	Mech. Attached Base Insulation, Bonded Top Insulation, Bonded Roof Cover	18-20
2B	Steel or Structural Concrete	New, Reroof (Tear-Off) or Recover	C	Mech. Attached Insulation, Bonded Roof Cover	21-25
2C	Steel or Structural Concrete	New, Reroof (Tear-Off) or Recover	D	Insulated, Mech. Attached Base Sheet, Bonded Roof Cover	26-28
3A	Concrete	New or Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	29-36
3B	Concrete	New or Reroof (Tear-Off)	A-3	Bonded Temp Roof/Vapor Barrier, Bonded Insulation, Bonded Roof Cover	36
3C	Concrete	New or Reroof (Tear-Off)	F	Non-insulated, Bonded Roof Cover	37
4A	LWIC	New or Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	38-39
4B	LWIC	New or Reroof (Tear-Off)	A-2	Mech. Attached Anchor Sheet, Bonded Insulation, Bonded Roof Cover	40
4C	LWIC	New, Reroof (Tear-Off)	E	Non-insulated, Mech. Attached Base Sheet, Bonded Roof Cover	41-44
5A	CWF	New or Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	45
5B	CWF	New or Reroof (Tear-Off)	A-2	Mech. Attached Anchor Sheet, Bonded Insulation, Bonded Roof Cover	46
5C	CWF	New, Reroof (Tear-Off) or Recover	C	Mech. Attached Insulation, Bonded Roof Cover	46
5D	CWF	New, Reroof (Tear-Off)	E	Non-insulated, Mech. Attached Base Sheet, Bonded Roof Cover	47
6A	Gypsum	Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	48-49
6B	Gypsum	Reroof (Tear-Off)	A-2	Mech. Attached Anchor Sheet, Bonded Insulation, Bonded Roof Cover	50
6C	Gypsum	Reroof (Tear-Off)	C	Mech. Attached Insulation, Bonded Roof Cover	51
6D	Gypsum	Reroof (Tear-Off)	E	Non-insulated, Mech. Attached Base Sheet, Bonded Roof Cover	51
7A	Various	Recover	A-1	Bonded Insulation, Bonded Roof Cover	52-57
7B	Various	Recover	F	Non-insulated, Bonded Roof Cover	57

**The following notes apply to the systems outlined herein:**

- The roof system evaluation herein pertains to above-deck roof components. Roof decks shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction. Load resistance of the roof deck shall be documented through proper codified and/or FBC Approval documentation.
- Unless otherwise noted, fasteners and stress plates for insulation attachment shall be as follows. Fasteners shall be of sufficient length for the following engagements:
  - Wood Deck:
    - OMG #14 Roofrip with Flat Bottom Plate (Accurac), OMG HD with OMG 3 in. Galvalume Steel Plate, Deckfast #14 with Hex Plate or 3" Round Insulation Plate, Trufast HD with Trufast 3" Metal Insulation Plates or FlintFast #14 Fastener with FlintFast 3" Insulation Plates. Minimum 0.75-inch plywood penetration or minimum 1-inch wood plank embedment.
    - Steel Deck:
      - OMG #12 or #14 Roofrip with Recessed or Flat Bottom Plate (Accurac), OMG #12 Standard or HD with OMG 3 in. Galvalume Steel Plate, Deckfast #12 or #14 with Hex Plate or 3" Round Insulation Plate, Trufast DP or HD with Trufast 3" Metal Insulation Plates or FlintFast #12 or #14 Fastener with FlintFast 3" Insulation Plates. Minimum 0.75-inch steel penetration and engage the top flure of the steel deck.
      - Structural Concrete:
        - OMG #14 Roofrip with Recessed or Flat Bottom Plate (Accurac), OMG HD or CD-10 with OMG 3 in. Galvalume Steel Plate, Deckfast #14 or DeckSpike with Hex Plate or 3" Round Insulation Plate, Trufast HD or CF with Trufast 3" Metal Insulation Plates or FlintFast #14 Fastener with FlintFast 3" Insulation Plates. Minimum 1-inch embedment. Fasteners installed with a pilot hole in accordance with the fastener manufacturer's published installation instructions.



3. Unless otherwise noted, insulation may be any one layer or combination of polyisocyanurate, polystyrene, wood fiberboard, perlite, Glasfloc Roof Board or gypsum-based roof board that meets the QA requirements of F.A.C. Rule 61G20-3 and is documented as meeting FBC 1505.1 and, for foam plastic, FBC Chapter 26, when installed with the roof cover.
4. Minimum 200 psi, minimum 2-inch thick lightweight insulating concrete may be substituted for, or installed beneath rigid insulation board for System Type D (mechanically attached base sheet, bonded roof cover), whereby the base sheet screws and plates are installed through the LWC to engage the structural steel or concrete deck. The structural deck shall be of equal or greater configuration to the steel and concrete deck listings. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction. Load resistance of the roof deck shall be documented through proper codified and/or FBC Approval documentation.
5. Preliminary insulation attachment for System Type D: Unless otherwise noted, refer to Section 2.2.10.1.3 of FM Loss Prevention Data Sheet 1-29 (January 2016).
6. Unless otherwise noted, insulation adhesive application rates are as follows. Ribbon or bead width is at the time of application; the ribbons/beads shall expand as noted in the manufacturer's published instructions.
  - Hot asphalt (HA): Full coverage at 25-30 lbs/square
  - Ashland Pliodeck (A-PD): Continuous 0.75 inch wide ribbons, 12-inch o.c. Ribbons of subsequent layers shall be perpendicular to those in the layer below.
  - Dow INSTA-STIK Quik Set Insulation Adhesive (D-IS): Continuous 0.75 to 1 inch wide ribbons, 12-inch o.c.
  - Millennium One Step Foamable Adhesive (M-OSFA): Continuous 0.25 to 0.5-inch wide ribbons, 12-inch o.c.
  - Millennium PG-1 Pump Grade Adhesive (M-PG1): Continuous 0.5 to 0.75-inch wide ribbons, 12-inch o.c.
  - OMG OlyBond 500 or OlyBond Green (OB500): Continuous 0.75-inch wide ribbons, 12-inch o.c. (Pacecart or SpotShot)
  - ICP Adhesives CR-20: Continuous 2.5 to 3-inch wide ribbons, 12-inch o.c.
  - *Note: When multiple layer(s) of insulation and/or coverboard are installed in ribbon-applied adhesive, boards shall be staggered from layer-to-layer.*
  - *Note: The maximum edge distance from the adhesive ribbon to the edge of the insulation board shall be not less than one-half the specified ribbons spacing.*
7. Unless otherwise noted, all insulations are flat-stock or taper board of the minimum thickness noted. Tapered polyisocyanurate at the following thickness limitations may be substituted with the following Maximum Design Pressure (MDP) limitations. In no case shall these values be used to 'increase' the MDP listings in the tables; rather if MDP listing below meets or exceeds that listed for a particular system in the tables, then the thinner board listed below may be used as a drop-in for the equivalent thicker material listed in the table:
 

➤ Ashland Pliodeck (A-PD) @ 12-inch o.c.	MDP -105.0 psf (Min. 1.0-inch)
➤ Ashland Pliodeck (A-PD) @ 6-inch o.c.	MDP -277.5 psf (Min. 1.0-inch)
➤ Dow INSTA-STIK Quik Set Insulation Adhesive (D-IS):	MDP -120.0 psf (Min. 1.0-inch)
➤ Millennium One Step Foamable Adhesive (M-OSFA):	MDP -157.5 psf (Min. 1.0-inch)
➤ Millennium PG-1 Pump Grade Adhesive (M-PG1):	MDP -157.5 psf (Min. 1.0-inch)
➤ OMG OlyBond 500 (OB500):	MDP -45.0 psf (Min. 0.5-inch Multi-Max FA3)
➤ OMG OlyBond 500 (OB500):	MDP -187.5 psf (Min. 0.5-inch ISO 95+ GL)
➤ OMG OlyBond 500 (OB500):	MDP -315.0 psf (Min. 0.5-inch ENRGY 3)
➤ OMG OlyBond 500 (OB500):	MDP -487.5 psf (Min. 0.5-inch ACFoam II)
➤ ICP Adhesives CR-20:	MDP -117.5 psf (Min. 1.0-inch)
8. Bonded polyisocyanurate insulation boards shall be maximum 4 x 4 ft.
9. For mechanically attached components or partially bonded insulation, the maximum design pressure for the selected assembly shall meet or exceed the Zone 1 design pressure determined in accordance with FBC Chapter 16, and Zones 2 and 3 shall employ an attachment density designed by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are ANSI/SPRI WD1, FM Loss Prevention Data Sheet 1-29 and Roofing Application Standard RAS 117. Assemblies marked with an asterisk\* carry the limitations set forth in Section 2.2.10.1 of FM Loss Prevention Data Sheet 1-29 (January 2016) for Zone 2/3 enhancements.
10. For assemblies with all components fully bonded in place, the maximum design pressure for the selected assembly shall meet or exceed critical design pressure determined in accordance with FBC Chapter 16, and no rational analysis is permitted.
11. For mechanically attached components over existing decks, fasteners shall be tested in the existing deck for withdrawal resistance. A qualified design professional shall review the data for comparison to the minimum requirements for the system. Testing and analysis shall be in accordance with ANSI/SPRI FX-1 or Testing Application Standard TAS 105.



12. For existing substrates in a bonded recover or re-roof installation, the existing roof surface or existing roof deck shall be examined for compatibility and bond performance with the selected adhesive, and the existing roof system (for recover) shall be capable of resisting project design pressures on its own merit to the satisfaction of the Authority Having Jurisdiction, as documented through field uplift testing in accordance with ANSI/SPRI A-1, ASTM E907, FM Loss Prevention Data Sheet 1-52 or Testing Application Standard TAS 124.
13. For Concrete Deck or Recover Applications using System Type D, the insulation is optional.
14. Lightweight Insulating Concrete (LWC) shall be cast in accordance with FBC Section 1917 to the satisfaction of the Authority Having Jurisdiction. For systems where specific LWC is referenced, refer to current LWC Product Approval for specific deck construction and limitations. For systems where specific LWC is not referenced, the minimum design mix shall be 3000 psi. In all cases, the minimum top-coat thickness is 2-inches. For LWC over structural concrete, reference is made to FBC Section 1917.4.1, Point 1
15. Unless otherwise noted, refer to the following references for bonded base, ply or cap sheet applications.

CERTAINTED FLINTLASTIC® MODIFIED BITUMEN COMPONENTS & APPLICATION METHODS			
Reference	Layer	Material	Application
BP-AA (Base and Ply sheets, Asphalt-Applied)	Base	Glasbase; All Weather/Empire Base; Flexiglas Base; Flintlastic Base 20	Hot asphalt at 20-40 lbs/square
	Ply	One or more Flintglas Ply 4; Flintglas Premium Ply 6	Hot asphalt in 24-inch diameter spots in 30-inch grid pattern
BP-AA2 (Base, Spot-Asphalt-Applied)	Base	Yosemite Venting Base	Hot asphalt in 9-inch diameter spots in grid pattern noted herein.
BP-AA3 (Base, Spot-Asphalt-Applied)	Base	Yosemite Venting Base	Hot asphalt in 9-inch wide ribbons spaced as noted herein.
BP-AA4 (Base, Strip-Asphalt-Applied)	Base	Yosemite Venting Base	Henry #903 Adhesive at 1.5 gal/square
BP-CA2	Base/Ply	Glasbase; All Weather/Empire Base; Flexiglas Base; Flintlastic Base 20	Millennium Hurricane Force Membrane Adhesive, beads spaced 6-inch o.c.
	Base/Ply	Glasbase; All Weather/Empire Base; Flexiglas Base; Flintlastic Base 20	
BP-CA3	Base	Flntlastic Base 20; Flintlastic Poly SMS Base; Flintlastic Ultra Poly SMS Base	
	Ply	One or more Flintlastic Base 20; Flintlastic Poly SMS Base; Flintlastic Ultra Poly SMS Base	
	Cap	Flntlastic Cap 30; Flintlastic Cap 30 CoolStar; Flintlastic FR Cap 30; Flintlastic FR Cap 30 CoolStar; Flintlastic FR Dual Cap; Flintlastic FR-P; Flintlastic FR-P CoolStar; Flintlastic Premium FR-P; Flintlastic Premium FR-P CoolStar; Flintlastic GMS; Flintlastic GMS CoolStar	Hot asphalt at 20-40 lbs/square
SBS-AA (SBS, Asphalt-Applied)	Base	Flntlastic Base 20; Flintlastic Poly SMS Base; Flintlastic Ultra Poly SMS Base	
	Note:	Base ply cures overnight prior to application of the ply or cap ply.	
	Ply	Flntlastic Base 20; Flintlastic Poly SMS Base; Flintlastic Ultra Poly SMS Base	FlntBond Brush or Karnak No. 81 Cold Process Modified Bitumen Adhesive Brush Grade at 1 gal/square
SBS-CA1 (SBS, Cold-Applied)	Cap	Flntlastic FR Cap 30; Flintlastic FR Cap 30 CoolStar; Flintlastic FR Dual Cap; Flintlastic FR-P; Flintlastic FR-P CoolStar; Flintlastic Premium FR-P; Flintlastic Premium FR-P CoolStar; Flintlastic GMS; Flintlastic GMS CoolStar	
	Base	Flntlastic Base 20; Flintlastic Poly SMS Base; Flintlastic Ultra Poly SMS Base	
	Ply	Flntlastic Base 20; Flintlastic Poly SMS Base; Flintlastic Ultra Poly SMS Base	
SBS-CA2 (SBS, Cold-Applied)	Cap	Flntlastic Cap 30; Flintlastic Cap 30 CoolStar; Flintlastic FR Cap 30; Flintlastic FR Cap 30 CoolStar; Flintlastic FR Dual Cap; Flintlastic FR-P; Flintlastic FR-P CoolStar; Flintlastic Premium FR-P; Flintlastic Premium FR-P CoolStar; Flintlastic GMS; Flintlastic GMS CoolStar	Henry #903 Adhesive at 1.5 gal/square



CERTAINTeED FLINTLASTIC® MODIFIED BITUMEN COMPONENTS & APPLICATION METHODS (CONTINUED)			
Reference	Layer	Material	Application
SBS-CA3 (SBS, Cold-Applied)	Base	Flintlastic Base 20; Flintlastic Poly SMS Base; Flintlastic Ultra Poly SMS Base	Millennium Hurricane Force Membrane Adhesive, beads spaced 6-inch o.c.
	Ply	Flintlastic Base 20; Flintlastic Poly SMS Base; Flintlastic Ultra Poly SMS Base	
	Cap	Flintlastic Cap 30; Flintlastic Cap 30 CoolStar; Flintlastic FR Cap 30; Flintlastic FR Cap 30 CoolStar; Flintlastic FR Dual Cap; Flintlastic FR-P; Flintlastic FR-P CoolStar; Flintlastic Premium FR-P; Flintlastic Premium FR-P CoolStar; Flintlastic GMS; Flintlastic GMS CoolStar	
SBS-TA (SBS, Torch-Applied)	Base	Flintlastic Ultra Poly SMS Base; Flintlastic Base 20 T	Torch-Applied
	Ply	One or more Flintlastic Ultra Poly SMS Base; Flintlastic Base 20 T	
	Cap	Flintlastic FR Cap 30 T; Flintlastic FR Cap 30 T CoolStar; Flintlastic GTS; Flintlastic GTS CoolStar; Flintlastic GTS-FR; Flintlastic GTS-FR CoolStar; Flintclad	
APP-TA (APP, Torch-Applied)	Base	One or more Flintlastic APP Base T; Flintlastic STA; Flintlastic STA Plus	Torch-Applied
	Cap	Flintlastic STA; Flintlastic STA Plus; Flintlastic GTA; Flintlastic GTA CoolStar; Flintlastic GTA-FR; Flintlastic GTA-FR CoolStar	
	Base/Ply	Black Diamond Base Sheet; Flintlastic Ultra Glass SA	
SBS-SA (SBS, Self-Adhering)	Base	Flintlastic SA PlyBase; Flintlastic SA Mid Ply	Self-Adhering
	Ply	Flintlastic SA PlyBase; Flintlastic SA Mid Ply	
	Cap	Flintlastic SA Cap; Flintlastic SA Cap CoolStar; Flintlastic SA Cap FR; Flintlastic SA Cap FR CoolStar	

16. "MDP" = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads. Refer to FBC 1609 for determination of design wind loads.



**TABLE 1E-1: WOOD DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)**  
SYSTEM TYPE E : NON-INSULATED, MECHANICALLY ATTACHED BASE SHEET, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Sheet		Roof Cover (Note 14)	MDP (psf)		
		Base	Fasteners			Attach	Ply
W-51	Min. 15/32-inch plywood at max 24-inch spans	Flintlastic SA NailBase	Simplex MAXXX Cap	9-inch o.c. at min. 3-inch lap and 12-inch o.c. in two (2), equally spaced, staggered center rows; Stress plates shall be primed with FlintPrime (ASTM D41) primer.	(Optional) SBS-SA	SBS-SA	-45.0*
W-52	Min. 15/32-inch plywood at max 24-inch spans	Flintlastic SA NailBase	Min. 1-inch long, 12 ga. Simplex Metal Cap Nails	6-inch o.c. at min. 2-inch lap and 6-inch o.c. in four (4), equally spaced, staggered center rows	(Optional) SBS-SA	SBS-SA	-52.5
W-53	Min. 19/32-inch plywood at max 24-inch spans	Flintlastic SA NailBase	32 ga., 1-5/8-inch dia. tin caps with 11 ga. annular ring shank nails	8-inch o.c. at min. 2-inch lap and 8-inch o.c. in three (3), equally spaced, staggered center rows	(Optional) SBS-SA	SBS-SA	-52.5
W-54	Min. 19/32-inch plywood at max. 24-inch spans	Flintlastic SA NailBase	32 ga., 1-5/8-inch dia. tin caps with 11 ga. annular ring shank nails	8-inch o.c. at min. 2-inch lap and 8-inch o.c. in three (3), equally spaced, staggered center rows	(Optional) SBS-SA	SBS-SA	-60.0
W-55	Min. 15/32-inch plywood at max 24-inch spans	Flintlastic SA NailBase	Simplex MAXXX Cap	8-inch o.c. at min. 3-inch lap and 8-inch o.c. in three (3), equally spaced, staggered center rows; Stress plates shall be primed with FlintPrime (ASTM D41) primer.	(Optional) SBS-SA	SBS-SA	-67.5
W-56	Min. 19/32-inch plywood at max 24-inch spans	Flintlastic SA NailBase	32 ga., 1-5/8-inch dia. tin caps with 11 ga. annular ring shank nails	6-inch o.c. at min. 2-inch lap and 6-inch o.c. in four (4), equally spaced, staggered center rows	(Optional) SBS-SA	SBS-SA	-75.0
W-57	Min. 15/32-inch plywood at max 24-inch spans	Flintlastic SA NailBase	Cap nails: 1-inch diameter, 0.032-inch thick metal cap with 0.120" shank diameter, annular ring shank nails	7-inch o.c. at min. 4-inch laps and 7-inch o.c. in five (5), equally spaced, staggered center rows	(Optional) SBS-SA	SBS-SA	-75.0
W-58	Min. 19/32-inch plywood at max 24-inch spans	Flintlastic SA NailBase	32 ga., 1-5/8-inch dia. tin caps with 11 ga. annular ring shank nails	4-inch o.c. at min. 2-inch lap and 4-inch o.c. in four (4), equally spaced, staggered center rows	(Optional) SBS-SA	SBS-SA	-105.0
<b>HYBRID SYSTEMS:</b>							
W-59	Min. 19/32-inch exterior grade plywood at max. 24-inch spans	Glasbase; FlexGlas; Flintlastic Base 20; All Weather / Empire Base; Poly SMS Base; Ultra Poly SMS Base	32 ga., 1-5/8-inch dia. tin caps with 11 ga. annular ring shank nails	9-inch o.c. at 4-inch lap and 12-inch o.c. in two (2), equally spaced, staggered center rows	SBS-SA-H	SBS-AA, SBS-TA or APP-TA	-45.0*
W-60	Min. 15/32-inch plywood at max 24-inch spans	Glasbase; FlexGlas; Flintlastic Base 20; All Weather / Empire Base; Poly SMS Base; Ultra Poly SMS Base	Min. 1-inch long, 12 ga. Simplex Metal Cap Nails	6-inch o.c. at 3-inch lap and 6-inch o.c. in four (4), equally spaced, staggered center rows	SBS-SA-H	SBS-AA, SBS-TA or APP-TA	-52.5



**TABLE 1E-1: WOOD DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)**  
 SYSTEM TYPE E: NON-INSULATED, MECHANICALLY ATTACHED BASE SHEET, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Sheet			Roof Cover (Note 14)	MDP (psf)
		Base	Fasteners	Attach		
W-61	Min. 19/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; Poly SMS Base; Ultra Poly SMS Base	32 ga., 1-5/8-inch dia. tin caps with 11 ga. annular ring shank nails	8-inch o.c. at 4-inch lap and 8-inch o.c. in three (3), equally spaced, staggered center rows	SBS-SA-H SBS-AA, SBS-TA or APP-TA	-52.5
W-62	Min. 19/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; Poly SMS Base; Ultra Poly SMS Base	32 ga., 1-5/8-inch dia. tin caps with 11 ga. annular ring shank nails	8-inch o.c. at 4-inch lap and 8-inch o.c. in three (3), equally spaced, staggered center rows	SBS-SA-H SBS-AA, SBS-TA or APP-TA	-60.0
W-63	Min. 19/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; Poly SMS Base; Ultra Poly SMS Base	32 ga., 1-5/8-inch dia. tin caps with 11 ga. annular ring shank nails	6-inch o.c. at 4-inch lap and 6-inch o.c. in four (4), equally spaced, staggered center rows	SBS-SA-H SBS-AA, SBS-TA or APP-TA	-82.5
W-64	Min. 19/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; Poly SMS Base; Ultra Poly SMS Base	32 ga., 1-5/8-inch dia. tin caps with 11 ga. annular ring shank nails	4-inch o.c. at 3-inch lap and 4-inch o.c. in four (4), equally spaced, staggered center rows	SBS-SA-H SBS-AA, SBS-TA or APP-TA	-105.0
<b>CONVENTIONAL SYSTEMS:</b>						
W-65	Min. 19/32-inch exterior grade plywood at max. 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; All Weather / Empire Base; Poly SMS Base; Ultra Poly SMS Base; Yosemite	32 ga., 1-5/8-inch dia. tin caps with 11 ga. annular ring shank nails	9-inch o.c. at 4-inch lap and 12-inch o.c. in two (2), equally spaced, staggered center rows	BP-AA, SBS-AA, SBS-TA or APP-TA	-45.0*
W-66	Min. 15/32-inch exterior grade plywood at max. 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; All Weather / Empire Base; Poly SMS Base; Yosemite	Simplex MAXX Cap	9-inch o.c. at 2-inch lap and 18-inch o.c. in two (2), equally spaced, staggered center rows	(Optional) BP-AA, SBS-AA, SBS-TA or APP-TA	-45.0*
W-67	Min. 15/32-inch exterior grade plywood at max. 24-inch spans	Flintlastic APP Base T	Simplex MAXX Cap	9-inch o.c. at 2-inch lap and 18-inch o.c. in two (2), equally spaced, staggered center rows	(Optional) APP-TA	-45.0*
W-68	Min. 15/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; All Weather / Empire Base; Poly SMS Base; Ultra Poly SMS Base; Yosemite	Min. 1-inch long, 12 ga. Simplex Metal Cap Nails	6-inch o.c. at 3-inch lap and 6-inch o.c. in four (4), equally spaced, staggered center rows	(Optional) BP-AA, SBS-AA, SBS-TA or APP-TA	-52.5
W-69	Min. 19/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; Poly SMS Base; Ultra Poly SMS Base; Yosemite	32 ga., 1-5/8-inch dia. tin caps with 11 ga. annular ring shank nails	8-inch o.c. at 4-inch lap and 8-inch o.c. in three (3), equally spaced, staggered center rows	BP-AA, SBS-AA, SBS-TA or APP-TA	-52.5
W-70	Min. 15/32-inch exterior grade plywood at max. 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; All Weather / Empire Base; Poly SMS Base; Yosemite	Simplex MAXX Cap	9-inch o.c. at 2-inch lap and 12-inch o.c. in two (2), equally spaced, staggered center rows	(Optional) BP-AA, SBS-AA, SBS-TA or APP-TA	-52.5
W-71	Min. 15/32-inch exterior grade plywood at max. 24-inch spans	Flintlastic APP Base T	Simplex MAXX Cap	9-inch o.c. at 2-inch lap and 12-inch o.c. in two (2), equally spaced, staggered center rows	(Optional) APP-TA	-52.5
W-72	Min. 19/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; Poly SMS Base; Ultra Poly SMS Base; Yosemite	32 ga., 1-5/8-inch dia. tin caps with 11 ga. annular ring shank nails	8-inch o.c. at 4-inch lap and 8-inch o.c. in three (3), equally spaced, staggered center rows	BP-AA, SBS-AA, SBS-TA or APP-TA	-60.0

Exterior Research and Design, LLC, d/b/a Trinity|ERD  
 Certificate of Authorization #9503  
 Prepared by: Robert Nieminen, PE-59166

6<sup>TH</sup> EDITION (2017) FBC NON-HVHZ EVALUATION  
**CertainTeed Flintlastic® Modified Bitumen Roof Systems; (610) 651-5847**

Evaluation Report 3520.03.04-R20 for FL2533-R19  
 Revision 20: 09/14/2017  
 Appendix 1, Page 14 of 57

**TABLE 1E-1: WOOD DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)**  
 SYSTEM TYPE E: NON-INSULATED, MECHANICALLY ATTACHED BASE SHEET, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Sheet			Roof Cover (Note 14)		MDP (psf)
		Base	Fasteners	Attach	Ply	Cap	
W-73	Min. 15/32-inch plywood at max 24-inch spans	Glasbase; Flexglas; Flintlastic Base 20; All Weather / Empire Base; Poly SMS Base; Ultra Poly SMS Base; Yosemite	Cap nails; 1-inch diameter, 0.032-inch thick metal cap with 0.120-inch shank diameter; annular ring shank nails.	6-inch o.c. at 4-inch lap and 6-inch o.c. at five (5) equally spaced, staggered center rows	(Optional) BP-AA, SBS-AA or SBS-TA	SBS-AA or SBS-TA	-67.5
W-74	Min. 19/32-inch plywood at max 24-inch spans	Glasbase; Flexglas; Flintlastic Base 20; Poly SMS Base; Ultra Poly SMS Base; Yosemite	32 ga., 1-5/8-inch dia. tin caps with 11 ga. annular ring shank nails	6-inch o.c. at 4-inch lap and 6-inch o.c. in four (4), equally spaced, staggered center rows	BP-AA, SBS-AA, SBS-TA or App-TA	SBS-AA, SBS-TA or App-TA	-82.5
W-75	Min. 15/32-inch exterior grade plywood at max. 24-inch spans	Glasbase; Flexglas; Flintlastic Base 20; All Weather / Empire Base; Poly SMS Base; Yosemite	Simplex MAXX Cap	6-inch o.c. at 2-inch lap and 6-inch o.c. in two (2), equally spaced, staggered center rows	(Optional) BP-AA, SBS-AA, SBS-TA or App-TA	SBS-AA, SBS-TA or App-TA	-90.0
W-76	Min. 15/32-inch exterior grade plywood at max. 24-inch spans	Flintlastic App Base T	Simplex MAXX Cap	6-inch o.c. at 2-inch lap and 6-inch o.c. in two (2), equally spaced, staggered center rows	(Optional) App-TA	App-TA	-90.0
W-77	Min. 19/32-inch plywood at max 24-inch spans	Glasbase; Flexglas; Flintlastic Base 20; Poly SMS Base; Ultra Poly SMS Base; Yosemite	32 ga., 1-5/8-inch dia. tin caps with 11 ga. annular ring shank nails	4-inch o.c. at 3-inch lap and 4-inch o.c. in four (4), equally spaced, staggered center rows	BP-AA, SBS-AA, SBS-TA or App-TA	SBS-AA, SBS-TA or App-TA	-105.0
W-78	Min. 15/32-inch exterior grade plywood at max. 24-inch spans	Glasbase; Flexglas; Flintlastic Base 20; All Weather / Empire Base; Poly SMS Base; Yosemite	Simplex MAXX Cap	6-inch o.c. at 2-inch lap and 6-inch o.c. in three (3), equally spaced, staggered center rows	(Optional) BP-AA, SBS-AA, SBS-TA or App-TA	SBS-AA, SBS-TA or App-TA	-105.0
W-79	Min. 15/32-inch exterior grade plywood at max. 24-inch spans	Flintlastic App Base T	Simplex MAXX Cap	6-inch o.c. at 2-inch lap and 6-inch o.c. in three (3), equally spaced, staggered center rows	(Optional) App-TA	App-TA	-105.0



**TABLE 1E-2: WOOD DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
 SYSTEM TYPE E: NON-INSULATED, MECHANICALLY ATTACHED BASE SHEET, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Sheet		Attach	Roof Cover (Note 14)		MDP (psf)
		Base	Fasteners		Ply	Cap	
<b>SELF-ADHERING SYSTEMS:</b>							
W-80	Min. 19/32-inch plywood at max 24-inch spans	Flintlastic SA Nailbase	Note 2	8-inch o.c. at min. 3-inch lap and 8-inch o.c. in two (2), equally spaced, staggered center rows. Stress plates shall be primed with FlintPrime (ASTM D41) primer or FlintPrime SA	(Optional) SBS-SA	SBS-SA	-82.5*
W-81	Min. 15/32-inch plywood at max 24-inch spans	Flintlastic SA Nailbase	Flintfast 3 in. Insulation Plates with FlintFast #12 or #14; Trufast 3" Metal Insulation Plates with DP or HD; OMG 3 in. Round Metal Plates with OMG #14 HD	6-inch o.c. at min. 2-inch lap and 6-inch o.c. in three (3), equally spaced, staggered center rows. Stress plates shall be primed with FlintPrime (ASTM D41) primer or FlintPrime SA	(Optional) SBS-SA	SBS-SA	-97.5*
W-82	Min. 15/32-inch plywood at max 24-inch spans	Flintlastic SA Nailbase	Flintfast 3 in. Insulation Plates with FlintFast #12 or #14; Trufast 3" Metal Insulation Plates with DP or HD; OMG 3 in. Round Metal Plates with OMG #14 HD	6-inch o.c. at min. 2-inch lap and 6-inch o.c. in four (4), equally spaced, staggered center rows. Stress plates shall be primed with FlintPrime (ASTM D41) primer or FlintPrime SA	(Optional) SBS-SA	SBS-SA	-127.5*
<b>HYBRID SYSTEMS:</b>							
W-83	Min. 15/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; Poly SMS Base; Ultra Poly SMS Base	Flintfast 3 in. Insulation Plates with FlintFast #12 or #14; Trufast 3" Metal Insulation Plates with DP or HD; OMG 3 in. Round Metal Plates with OMG #14 HD	6-inch o.c. at 4-inch lap and 6-inch o.c. in three (3), equally spaced, staggered center rows. Stress plates shall be primed with FlintPrime (ASTM D41) primer or FlintPrime SA	SBS-SA-H	SBS-AA, SBS-TA or App-TA	-97.5
W-84	Min. 19/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; Poly SMS Base; Ultra Poly SMS Base	Note 2	7-inch o.c. at 3-inch lap and 7-inch o.c. in three (3), equally spaced, staggered center rows	SBS-SA-H	SBS-AA, SBS-TA or App-TA	-105.0
W-85	Min. 15/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; Poly SMS Base; Ultra Poly SMS Base	Flintfast 3 in. Insulation Plates with FlintFast #12 or #14; Trufast 3" Metal Insulation Plates with DP or HD; OMG 3 in. Round Metal Plates with OMG #14 HD	6-inch o.c. at 4-inch lap and 6-inch o.c. in four (4), equally spaced, staggered center rows. Stress plates shall be primed with FlintPrime (ASTM D41) primer or FlintPrime SA	SBS-SA-H	SBS-AA, SBS-TA or App-TA	-127.5
<b>CONVENTIONAL SYSTEMS:</b>							
W-86	Min. 23/32-inch exterior grade plywood at max 24-inch spans	Glasbase; All Weather/Empire Base; Flexiglas Base; Flintlastic Base 20; Yosemite	Note 2	12-inch o.c. at 4-inch lap and 36-inch o.c. in two (2), equally spaced, staggered center rows	BP-AA, SBS-AA, SBS-TA or App-TA	SBS-AA, SBS-TA or App-TA	-30.0*
W-87	Min. 23/32-inch exterior grade plywood at max 24-inch spans	Glasbase; All Weather/Empire Base; Flexiglas Base; Flintlastic Base 20; Yosemite	Note 2	12-inch o.c. at 4-inch lap and 24-inch o.c. in two (2), equally spaced, staggered center rows	BP-AA, SBS-AA, SBS-TA or App-TA	SBS-AA, SBS-TA or App-TA	-45.0*
W-88	Min. 23/32-inch exterior grade plywood at max 24-inch spans	Poly SMS Base; Ultra Poly SMS Base	Note 2	12-inch o.c. at 4-inch lap and 36-inch o.c. in two (2), equally spaced, staggered center rows	BP-AA, SBS-AA, SBS-TA or App-TA	SBS-AA, SBS-TA or App-TA	-45.0*

**TABLE 1E-2: WOOD DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
SYSTEM TYPE E: NON-INSULATED, MECHANICALLY ATTACHED BASE SHEET, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Sheet			Attach	Roof Cover (Note 14)		MDP (psf)
		Base	Fasteners	Ply		Cap		
W-89	Min. 15/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; Poly SMS Base; Ultra Poly SMS Base; Yosemite	Flintfast 3 in. Insulation Plates with Flintfast #12 or #14; Trufast 3" Metal Insulation Plates with DP or HD; OMG 3 in. Round Metal Plates with OMG #14 HD	6-inch o.c. at 4-inch lap and 6-inch o.c. in three (3), equally spaced, staggered center rows	(Optional) BP-AA, SBS-AA, SBS-TA or APP-TA	SBS-AA, SBS-TA or APP-TA	-97.5	
W-90	Min. 15/32-inch plywood at max 24-inch spans	Flintlastic APP Base T	OMG 3 in. Round Metal Plates with OMG #14 HD	6-inch o.c. at 4-inch lap and 6-inch o.c. in three (3), equally spaced, staggered center rows.	APP-TA	APP-TA	-97.5	
W-91	Min. 15/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; All Weather / Empire Base; Poly SMS Base; Ultra Poly SMS Base; Yosemite	Flintfast 3 in. Insulation Plates with Flintfast #14; Trufast 3" Metal Insulation Plates with Trufast HD	8-inch o.c. at 4-inch lap and 8-inch o.c. at three (3) equally spaced, staggered center rows	(Optional) BP-AA, SBS-AA or SBS-TA	SBS-AA or SBS-TA	-97.5	
W-92	Min. 19/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; Poly SMS Base; Ultra Poly SMS Base; Yosemite	Note 2	7-inch o.c. at 3-inch lap and 7-inch o.c. in three (3), equally spaced, staggered center rows	BP-AA, SBS-AA, SBS-TA or APP-TA	SBS-AA, SBS-TA or APP-TA	-105.0	
W-93	Min. 19/32-inch plywood at max 24-inch spans	Flintlastic APP Base T	OMG 3 in. Round Metal Plates with OMG #14 HD or Dekfast Hex Plate with Dekfast #14	7-inch o.c. at 3-inch lap and 7-inch o.c. in three (3), equally spaced, staggered center rows	APP-TA	APP-TA	-105.0	
W-94	Min. 15/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas; Flintlastic Base 20; Poly SMS Base; Ultra Poly SMS Base; Yosemite	Flintfast 3 in. Insulation Plates with Flintfast #12 or #14; Trufast 3" Metal Insulation Plates with DP or HD; OMG 3 in. Round Metal Plates with OMG #14 HD	6-inch o.c. at 4-inch lap and 6-inch o.c. in four (4), equally spaced, staggered center rows	(Optional) BP-AA, SBS-AA, SBS-TA or APP-TA	SBS-AA, SBS-TA or APP-TA	-127.5	
W-95	Min. 15/32-inch plywood at max 24-inch spans	Flintlastic APP Base T	OMG 3 in. Round Metal Plates with OMG #14 HD	6-inch o.c. at 4-inch lap and 6-inch o.c. in four (4), equally spaced, staggered center rows.	APP-TA	APP-TA	-127.5	
<b>COLD-APPLIED SYSTEMS:</b>								
W-96	Min. 15/32-inch plywood at max 24-inch spans	Glasbase; Flexiglas Base; Flintlastic Base 20; All Weather / Empire Base; Yosemite Venting Base; Flintlastic Poly SMS Base; Flintlastic Ultra Poly SMS Base	Flintfast 3 in. Insulation Plates with Flintfast #12 or #14; Trufast 3" Metal Insulation Plates with DP or HD	8-inch o.c. at 4-inch lap and 8-inch o.c. in three (3), equally spaced, staggered center rows	(Optional) SBS-CA1	SBS-CA1	-52.5	

**TABLE 1F: WOOD DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)**  
SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER

System No.	Deck (Note 1)	Primer	Roof Cover (Note 14)		MDP (psf)
			Base	Ply	
W-97	Min. 15/32-inch plywood at max 24-inch spans	FlintPrime or FlintPrime SA	SBS-SA-H	(Optional) SBS-TA, APP-TA	-112.5
W-98	Min. 15/32-inch plywood at max 24-inch spans	FlintPrime or FlintPrime SA	SBS-SA	(Optional) SBS-SA	-127.5



**Product Approval**  
USER: Public User

[Product Approval Menu](#) > [Product or Application Search](#) > [Application List](#) > **Application Detail**

▶ OFFICE OF THE SECRETARY

FL #	FL21841-R2
Application Type	Revision
Code Version	2017
Application Status	Approved
Comments	
Archived	<input type="checkbox"/>
Product Manufacturer	CertainTeed Corporation-Roofing
Address/Phone/Email	20 Moores Road Malvern, PA 19355 (610) 893-5400 mark.d.harner@saint-gobain.com
Authorized Signature	Mark Harner mark.d.harner@saint-gobain.com
Technical Representative	Mark D. Harner
Address/Phone/Email	18 Moores Road Malvern, PA 19355 (610) 651-5847 Mark.D.Harner@saint-gobain.com
Quality Assurance Representative	
Address/Phone/Email	
Category	Roofing
Subcategory	Underlayments
Compliance Method	Evaluation Report from a Florida Registered Architect or a Licensed Florida Professional Engineer <input type="checkbox"/> Evaluation Report - Hardcopy Received
Florida Engineer or Architect Name who developed the Evaluation Report	Robert Nieminen
Florida License	PE-59166
Quality Assurance Entity	QAI Laboratories
Quality Assurance Contract Expiration Date	01/01/2023
Validated By	John W. Knezevich, PE <input checked="" type="checkbox"/> Validation Checklist - Hardcopy Received
Certificate of Independence	<a href="#">FL21841 R2 COI 2017 01 COI Nieminen.pdf</a>
Referenced Standard and Year (of Standard)	<b>Standard</b> ASTM D1970 (tear)
	<b>Year</b> 2015



Equivalence of Product Standards  
 Certified By

Sections from the Code

Product Approval Method Method 1 Option D

Date Submitted 09/06/2017  
 Date Validated 09/12/2017  
 Date Pending FBC Approval 09/15/2017  
 Date Approved 12/12/2017  
 Date Revised 03/19/2018

### Summary of Products

FL #	Model, Number or Name	Description
21841.1	RoofRunner High Performance Synthetic Underlayment	Synthetic underlayment for use with asphalt-shingle roof systems
<b>Limits of Use</b> Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: N/A Design Pressure: N/A Other: Refer to ER Section 5 for Limits of Use.		<b>Installation Instructions</b> <a href="#">FL21841 R2 II 2017 09 FINAL CERTAINTeed ROOFRUNNER FL21841-R2.pdf</a> Verified By: Robert Nieminen PE-59166 Created by Independent Third Party: Yes <b>Evaluation Reports</b> <a href="#">FL21841 R2 AE 2017 09 FINAL CERTAINTeed ROOFRUNNER FL21841-R2.pdf</a> Created by Independent Third Party: Yes

[Back](#) [Next](#)

Contact Us :: 2601 Blair Stone Road, Tallahassee FL 32399 Phone: 850-487-1824

The State of Florida is an AA/EEO employer. [Copyright 2007-2013 State of Florida](#) :: [Privacy Statement](#) :: [Accessibility Statement](#) :: [Refund Statement](#)

Under Florida law, email addresses are public records. If you do not want your e-mail address released in response to a public-records request, do not send electronic mail to this entity. Instead, contact the office by phone or by traditional mail. If you have any questions, please contact 850.487.1395. \*Pursuant to Section 455.275 (1), Florida Statutes, effective October 1, 2012, licensees licensed under Chapter 455, F.S. must provide the Department with an email address if they have one. The emails provided may be used for official communication with the licensee. However email addresses are public record. If you do not wish to supply a personal address, please provide the Department with an email address which can be made available to the public. To determine if you are a licensee under Chapter 455, F.S., please click [here](#).

Product Approval Accepts:



Credit Card  
**Safe**

**SECURITYMETRICS**



**EXTERIOR RESEARCH & DESIGN, LLC.**

*Certificate of Authorization #9503*  
353 CHRISTIAN STREET, UNIT #13  
OXFORD, CT 06478  
(203) 262-9245

**EVALUATION REPORT**

**CertainTeed Corporation**  
20 Moores Road  
Malvern, PA 19355  
**(610) 651-5847**

**Evaluation Report 13500.02.17-R2**  
**FL21841-R2**  
**Date of Issuance: 02/10/2017**  
**Revision 2: 09/05/2017**

**SCOPE:**

This Evaluation Report is issued under **Rule 61G20-3** and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for use of the product under the Florida Building Code and Florida Building Code, Residential Volume. The products described herein have been evaluated for compliance with the **6<sup>th</sup> Edition (2017) Florida Building Code** sections noted herein.

**DESCRIPTION: RoofRunner™ High Performance Synthetic Roofing Underlayment**

**LABELING:** Labeling shall be in accordance with the requirements the Accredited Quality Assurance Agency noted herein.

**CONTINUED COMPLIANCE:** This Evaluation Report is valid until such time as the named product(s) changes, the referenced Quality Assurance documentation changes, or provisions of the Code that relate to the product change. Acceptance of this Evaluation Report by the named client constitutes agreement to notify Robert Nieminen, P.E. if the product changes or the referenced Quality Assurance documentation changes. Trinity|ERD requires a complete review of this Evaluation Report relative to updated Code requirements with each Code Cycle.

**ADVERTISEMENT:** The Evaluation Report number preceded by the words "Trinity|ERD Evaluated" may be displayed in advertising literature. If any portion of the Evaluation Report is displayed, then it shall be done in its entirety.

**INSPECTION:** Upon request, a copy of this entire Evaluation Report shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This Evaluation Report consists of pages 1 through 3.

**Prepared by:**

**Robert J.M. Nieminen, P.E.**  
*Florida Registration No. 59166, Florida DCA ANE1983*



The facsimile seal appearing was authorized by Robert Nieminen, P.E. on 09/05/2017. This does not serve as an electronically signed document.

**CERTIFICATION OF INDEPENDENCE:**

1. Trinity|ERD does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. Trinity|ERD is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have nor will acquire, a financial interest in any company manufacturing or distributing products for which the evaluation reports are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither Trinity|ERD nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this Evaluation Report, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

**ROOFING COMPONENT EVALUATION:**
**1. SCOPE:**
**Product Category:** Roofing

**Sub-Category:** Underlayment

**Compliance Statement:** **RoofRunner™ High Performance Synthetic Roofing Underlayment**, as produced by **CertainTeed Corporation**, has demonstrated compliance with the following sections of the **6<sup>th</sup> Edition (2017) Florida Building Code** through testing in accordance with applicable sections of the following Standards. Compliance is subject to the Installation Requirements and Limitations / Conditions of Use set forth herein.

**2. STANDARDS:**

<u>Section</u>	<u>Properties</u>	<u>Standard</u>	<u>Year</u>
1507.2.3 / 1507.1.1	Unrolling, Breaking Strength, Pliability	ASTM D226	2009
1507.1.1	Tear strength	ASTM D1970	2015

**3. REFERENCES:**

<u>Entity</u>	<u>Examination</u>	<u>Reference</u>	<u>Date</u>
ERD (TST6049)	Tear strength	CTR-SC16080.17	07/31/2017
QAI (TST9808)	Physical Properties, AC188	RJ3502P-1	11/05/2014
QAI (QUA7628)	Traceability/Inspections	Service Confirmation	02/09/2017

**4. PRODUCT DESCRIPTION:**

4.1 **RoofRunner™** is a synthetic polymer-based scrim-reinforced underlayment designed for use on roof decks as a water-resistant layer beneath asphalt roofing shingles; meets ASTM D226 physical property requirements and ASTM D1970 tear strength per the **Exception of FBC 1507.1.1**. **RoofRunner™** consists of a woven polyolefin base with a layer of nonwoven polyolefin sheet and a polymer coating on the back side. **RoofRunner™** is available in rolls 48-inch x 250-ft; nominal unit weight of 2.25 lbs/square.

**5. LIMITATIONS:**

5.1 This is a building code evaluation. Neither Trinity|ERD nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this Evaluation Report, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

5.2 This Evaluation Report is not for use in FBC HVHZ jurisdictions.

5.3 Fire Classification is not part of this Evaluation Report; refer to current Approved Roofing Materials Directory or test report from accredited testing/listing agency for fire ratings of this product.

5.4 **RoofRunner™** may be used with any prepared roof cover where the product is specifically referenced within FBC approval documents. If not listed, a request may be made to the Authority Having Jurisdiction for approval based on this evaluation combined with supporting data for the prepared roof covering.

5.5 **RoofRunner™** shall not be installed on roof slopes below 2:12.

5.6 **Allowable roof covers:**

TABLE 1: ROOF COVER OPTIONS						
Underlayment	Asphalt Shingles	Nail-On Tile	Foam-On Tile	Metal	Wood Shakes & Shingles	Slate
RoofRunner™	Yes	No	No	No	No	No

5.7 **Exposure Limitations:**

CertainTeed recommends primary roofing be installed within 48 hours of underlayment installation for re-roof applications or within 10-days of underlayment installation for new construction applications.

## 6. INSTALLATION:

- 6.1 **RoofRunner™ High Performance Synthetic Roofing Underlayment** shall be installed in accordance with **CertainTeed Corporation** published installation instructions subject to the Limitations set forth in Section 5 herein and the specifics noted below.
- 6.2 Install in compliance with the requirements for ASTM D226 underlayment in **FBC 1507.1.1**, taking into account the wider sheet-width of **RoofRunner™** for double-layer applications.
- 6.3 Re-fasten any loose decking panels, and check for protruding nail heads. Sweep the substrate thoroughly to remove any dust and debris prior to application.
- 6.4 Corrosion resistant fasteners shall be plastic cap nails with minimum 1-inch diameter head. **Do not use staples.** Ensure fasteners are installed at 90 degree angle to the deck with flush contact between the plastic cap or metal cap and the upper surface of the underlayment. Fasteners shall be of sufficient length to penetrate through the underside of plywood or OSB decks, or minimum ¾-inch embedment into dimensional lumber / tongue-and-groove wood decks.
- 6.5 Install a leak barrier of ASTM D1970, such as **CertainTeed WinterGuard (FL11288)**, or equal holding Florida Statewide Product Approval at vulnerable leak areas, including but not limited to eaves, valleys, rakes, skylights and dormers. At eaves and valleys, install the leak barrier prior to installation of **RoofRunner™**. Along the rake, install **RoofRunner™**, leaving 6 to 8-inch of the deck exposed, and then install the leak barrier over the **RoofRunner™** and exposed decking. At other areas, install the leak barrier over the **RoofRunner™**.
- 6.6 Single Layer; Roof Slope > 4:12:  
Starting at the eave, lay printed-side up and fasten at the circular targets printed on the top surface; 15-inch o.c. vertically and 12-inch o.c. horizontally (parallel to eaves). On vertical side/end laps install 8 fasteners equally spaced at 6-inch o.c. centered in the lap to hold the underlayment in place. Continue upslope in a similar manner, maintaining minimum 3-inch wide horizontal and minimum 6-inch wide vertical laps, and fasten as noted above. Offset vertical end laps from course to course at least 3 feet.
- 6.7 Double Layer; 2:12 < Roof Slope < 4:12:  
Starting at the eave, lay a 25.5-inch wide starter strip, printed-side up and fastened to hold in place. Then install a full 48-inch wide sheet, printed-side up, over the starter strip and fasten at the circular targets printed on the top surface; 15-inch o.c. vertically and 12-inch o.c. horizontally (parallel to eaves). On vertical side/end laps install 8 fasteners equally spaced at 6-inch o.c. centered in the lap to hold the underlayment in place. Continue upslope in a similar manner, maintaining minimum 25.5-inch wide horizontal laps (resulting in maximum 22.5-inch exposure) and minimum 12-inch wide vertical laps, and fasten as noted above. Offset vertical end laps from course to course at least 3 feet. Offset vertical end laps from course to course at least 3 feet.
- 6.8 **RoofRunner™** may not be used in any exposed application, including but not limited to crickets, exposed valleys or exposed roof to wall details.

## 7. BUILDING PERMIT REQUIREMENTS:

As required by the Building Official or Authority Having Jurisdiction in order to properly evaluate the installation of this product.

## 8. MANUFACTURING PLANTS:

Dadra, India

## 9. QUALITY ASSURANCE ENTITY:

Quality Auditing Institute, Ltd. – QUA7628; (604) 527-8378, [mlansdowne@qai.org](mailto:mlansdowne@qai.org)

- END OF EVALUATION REPORT -